


**ASCO**<sup>®</sup> 7000 Series  
*We Keep Your Power On*<sup>®</sup>

Power Switching and  
Control Solutions for  
Critical and Distributed  
Power Applications

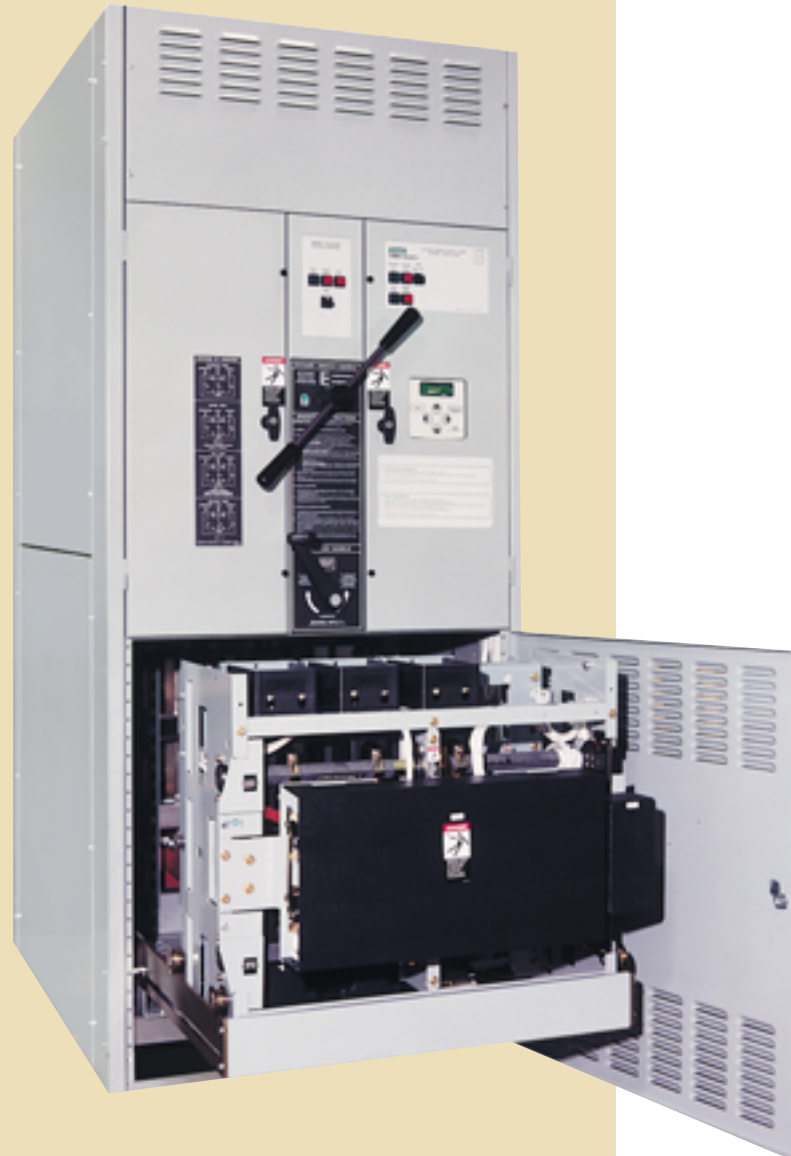

4016 Quartz Drive  
Santa Rosa, CA 95405  
Phone: 707 539-9003  
Fax: 707 539-5212  
Email: [sales@generatorjoe.NET](mailto:sales@generatorjoe.NET)  
Web [www.generatorjoe.NET](http://www.generatorjoe.NET)

**GeneratorJoe**



## Critical Loads Demand **ASCO**

Healthcare Facilities  
Commercial Buildings/Industrial Buildings  
Web Hosting, Internet Data Centers  
Telecom Central Offices  
Process Manufacturing/Wafer Fabrication Plants/  
Distributed Power/Load Management

As we become more dependent on the quality and reliability of electrical power, interruption or complete loss of power can create serious and even crippling financial losses, or impose dangers to life and safety.

ASCO Power Technologies (ASCO) provides the solutions to handle the transfer of critical loads to emergency sources reliably and with state of the art products. Using ASCO products can mean the difference between a minor inconvenience and a major catastrophe. You'll find ASCO Power Transfer Switches wherever there is a critical load to be protected.

When flexibility in power switching is a must, ASCO offers a variety of product solutions to meet virtually every application requirement, including distributed generation applications. That's why the 7000 Series is available in open, delayed, closed and closed soft load configurations. Additionally, switched or overlapping neutral options provide for reliable operation of ground fault protection systems and reduction of voltage transients from unbalanced load switching.

ASCO Power Transfer Switches are the first CE Marked, IEC 60947-6-1 compliant Transfer Switches in the world which have been certified by a notified body of the European Union.



4016 Quartz Drive  
Santa Rosa, CA 95405  
Phone: 707 539-9003  
Fax: 707 539-5212  
Email: sales@generatorjoe.NET  
Web www.generatorjoe.NET

**GeneratorJoe**

## **ASCO** The Recognized Leader in Power Transfer Switch Technology Offers the Most Advanced Transfer Switches in the World.

### 7000 Series

ASCO Power Transfer Switches are the standard of the industry. High speed transfer of loads between alternate sources of power, regardless of ampacity size, is achieved by a reliable, field proven solenoid operating mechanism. When combined with a programmable microprocessor controller with keypad and LCD display, they offer the most advanced method of transferring all types of loads, such as motors, electronic drives, UPSs and microprocessor based systems. 7000 Series Power Transfer Switches are available open or enclosed, in ampacity sizes from 30 through 4000 amperes with the largest selection of optional accessories offered anywhere.



Fig. 1: Three Pole 7000 Series Automatic Transfer Switch rated 1600 amperes (shown with optional front connected terminals and Power Manager).

### 7000 Series Power Transfer Switches Product Features

- Conventional two-position transfer configuration, plus closed and delayed transition modes of operation. All configurations available with either automatic or non-automatic control.
- UL listed to 1008 Transfer Switch Equipment & CSA certified to CSA 22.2 No.178-1978 Automatic Transfer Switches.
- Independently qualified and certified listed to IEC 60947-6-1, CE marked (optional). (Limited to certain accessories.)
- Rated up to 600 VAC, 30 through 4000 amperes.
- Reliable and field proven solenoid operating mechanism.
- High withstand and close-on ratings including short time withstand current rating for optimum flexibility in circuit breaker coordination (600-4000 amperes).
- Solid, switched, or overlapping neutral conductor options.
- Front replaceable main and arcing contacts (600-4000 amperes).
- Programmable microprocessor controller with keypad and LCD display.
- Centrally located terminal block for customer control connections (260-4000 amperes).
- 16mm, industrial grade control switches and indicating lights.
- Switch position LED indicators and true source acceptability lights.
- Standard ground conductor connections.
- Four auxiliary contacts, two contacts closed when switch is in normal position and two contacts closed when switch is in emergency position.
- Local/remote communications capability for interfacing with ASCO PowerQuest® VPi or SiteWeb™ communication products.





**Fig. 2:** Four pole, Closed-Transition Transfer Switch rated 1000 amperes in Type 1 enclosure.

### Closed-Transition Transfer Switching

ASCO Automatic Closed-Transition Transfer Switches feature main contacts that overlap, permitting the transfer of electrical loads without power interruption. The switch transfers in a make-before-break mode if both sources are within acceptable parameters. Control logic continuously monitors source conditions and automatically determines whether the load transfer should be open (conventional non-overlap mode) or closed transition. Available 150 through 4000 amperes.

Closed-Transition Transfer within 5 electrical degrees is achieved passively, without control of engine generator set. Therefore, no additional control wire runs are required between the ATS and engine generator set governor. Plus, protective relaying may not be required under normal operation since the contact overlap time is less than 100 milliseconds (consult your local utility on protective relay requirements).

Failure to synchronize indication and extended parallel time protection is built-in to all 7000 Series closed transition controls to prevent abnormal operation.



**Fig. 3:** Four pole, Delayed-Transition Transfer Switch rated 2000 amperes.

### Delayed Transition Transfer Switching

ASCO Delayed Transition Transfer Switches are designed to provide transfer of loads between power sources with a timed load disconnect position for an adjustable period of time. Applications include older style variable frequency drives, rectifier banks, and load management applications.

- Available 150 through 4000 amperes.
- Utilizes reliable, field proven solenoid operating mechanisms.
- Mechanical interlocks to prevent direct connection of both sources.
- Indicator light (16mm, industrial grade type LED) for load disconnect position.
- Adjustable time delay for load disconnect position.



4016 Quartz Drive  
 Santa Rosa, CA 95405  
 Phone: 707 539-9003  
 Fax: 707 539-5212  
 Email: sales@generatorjoe.NET  
 Web www.generatorjoe.NET

### Non-Automatic Transfer Switching

ASCO Non-Automatic Transfer Switches are electrically operated units which are operated with manual control switches mounted locally or at remote locations.

- Sizes from 30 through 4000 amperes.
- Microprocessor based controller provides for addition of optional accessories.
- Controller prevents inadvertent operation under low voltage conditions.
- Low control circuit operating currents allow for long line runs between remotely mounted manual control switches and the transfer switch.
- Source acceptability lights inform operator if sources are available to accept load.
- Standard inphase monitor can be activated for transferring motor loads.



**Fig. 4:** Three pole Non-Automatic, electrically operated 400 ampere switch shown in Type 1 enclosure.

### Withstand and Close-On Ratings for all 7000 Series Products<sup>(1)(2)</sup>

Switch Rating (Amps)		UL 1008 Withstand and Close-On Ratings at 480 Volts AC				Short Time Withstand Ratings <sup>(4)</sup>
Transfer Switches	Bypass Switches	Current - Limiting Fuse Rating	Max. Fuse Type amps types	Specific Breaker Rating	"Any" Breaker <sup>(3)</sup> Rating	
30	-	100,000	60 J	10,000	10,000	N/A
70, 100, 150	-	200,000	200 J	22,000	10,000	N/A
260, 400	150, 260, 400	200,000	600 J	42,000	35,000	N/A
600, 800, 1000, 1200	600, 800	200,000	1600 <sup>(6)</sup> L	65,000	50,000	36,000 <sup>(5)</sup>
-	1000, 1200	200,000	2000 L	85,000	85,000	65,000
1600, 2000 <sup>(7)</sup>	1600, 2000	200,000	3000 L	100,000	100,000	65,000
3000	3000	200,000	4000 L	100,000	100,000	65,000
4000	4000	200,000	6000 L	100,000	100,000	65,000

Notes: 1) All values are available symmetrical RMS amperes and tested in accordance with the withstand and close-on requirements of UL 1008. See publication 1128 for more information on withstand and close-on ratings for ASCO transfer switches.

2) Application requirements may permit higher withstand ratings for certain size switches. Contact ASCO for guidance if available short circuit current exceeds the WCR ratings shown.

3) "Any" breaker ratings are based on 1.5 cycles for 30 - 150 amp & 3 cycles for 260 - 4000 amps. Applicable to breakers with instantaneous trip elements.

4) Short time ratings are provided for applications involving breakers that do not have instantaneous trips for system coordination.

5) Short time rating applicable to transfer switch design only.

6) Maximum fuse size limited to 1200 amp for 600 & 800 amp bypass switches

7) Optional front connected service limited to 85,000 amps for specific and any breaker rating.



### Automatic Transfer Bypass-Isolation Switching


ASCO Automatic Transfer & Bypass-Isolation Switches are available in open transition, closed transition and delayed transition designs. The bypass and isolation features allow power transfer switches to be inspected, tested, and maintained without any interruption of power to the load.

- Available 150 to 4000 amperes.
- Allows bypass-isolation without load interruption.
- Bypass switch and transfer switch have identical electrical ratings.
- Heavy duty mechanical interlocks prevent undesirable operation.
- Bypass contacts carry current only during bypass mode.
- Transfer switch is drawout design for ease of maintenance.
- Bypass and isolation handles are permanently mounted. The bypass switch has dead front quick-make, quick-break operation for transferring of loads between live sources.
- Bypass switch is fully rated for use as a manual 3-position transfer switch.
- Bypass and isolation functions are simple, requiring a total of two operating handles.
- No toggle switches, push buttons, selector switches or levers are required for bypass-isolation operation.
- Mechanical indicators show bypass and transfer switch positions.



Fig. 5: Four pole Bypass-Isolation Transfer Switch rated 2000 Amperes.

### Transfer Switch Drawout Features (1000-3000 amperes)

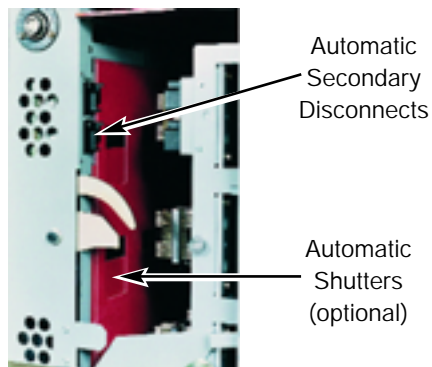

- Automatic secondary disconnects remove all control power as switch is withdrawn.
- Drawout carriage provides for easy transfer switch maintenance and/or removal via commercially available breaker hoists.
- For optional transfer switch lifting yoke, specify accessory 82B.
- For optional automatic shutters which close when the transfer switch is withdrawn to provide bus isolation, specify accessory 82C.

Fig. 6: Bypass-Isolation Transfer Switch secondary disconnects and optional automatic shutters.

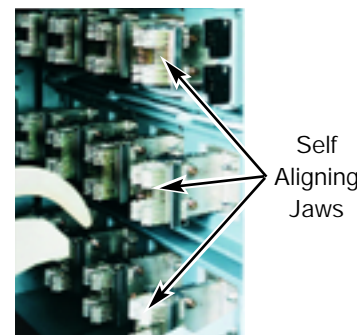
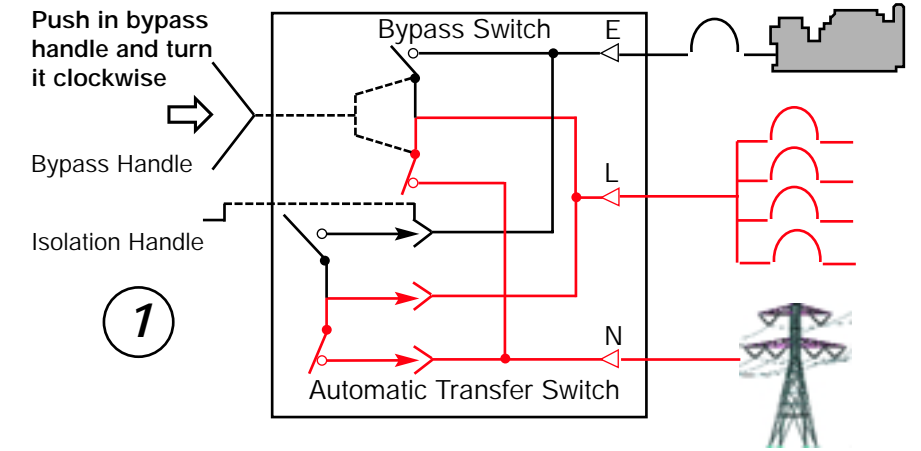


Fig. 7: Bypass-Isolation Transfer Switch self aligning power jaws.

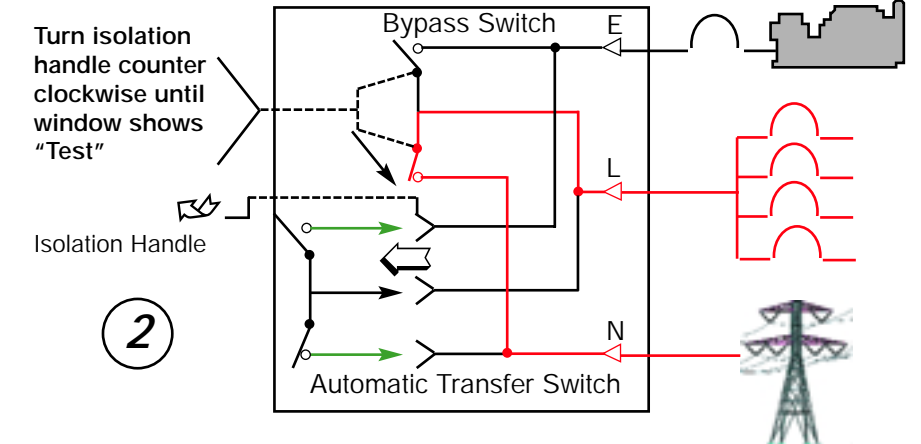


Fig. 8 Bypass-Isolation Switch user interface (1000-3000 amperes shown).


### Bypass to Normal



### Test Position



### Isolation Position

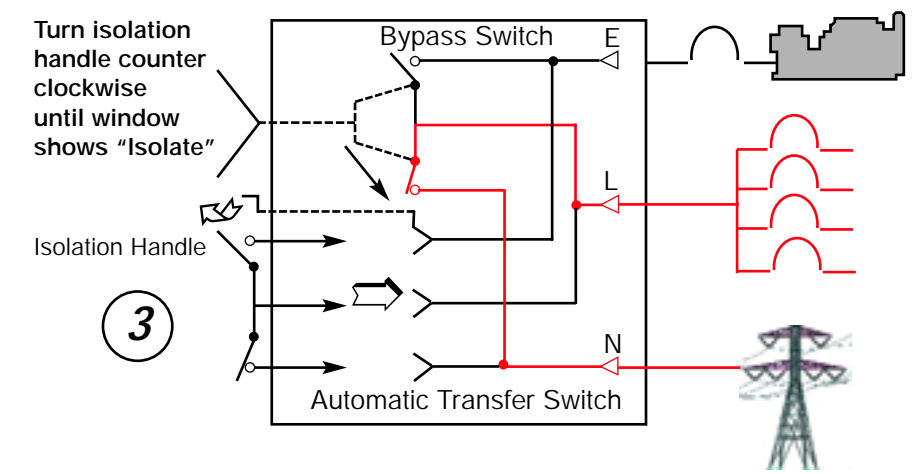


**Key:**

- Red line: Represents Current Flow
- Green line: In test position control panel remains energized to allow for electrical operation of a transfer switch.



The ASCO Service Entrance Power Transfer Switch combines automatic power switching with a disconnect and overcurrent protective device on the utility source. The power transfer switch meets all National Electric Code requirements for installation at a facility's main utility service entrance. Service entrance rated transfer switches generally are installed at facilities that have a single utility feed and a single emergency power source. A circuit breaker serves as the utility disconnect and links are provided to disconnect both neutral and ground connections.

This product is UL 1008 and UL 891 listed and is available up to 600V and 4000A in Standard, Delayed, Closed Transition, Soft Load, and Bypass Isolation Configurations.

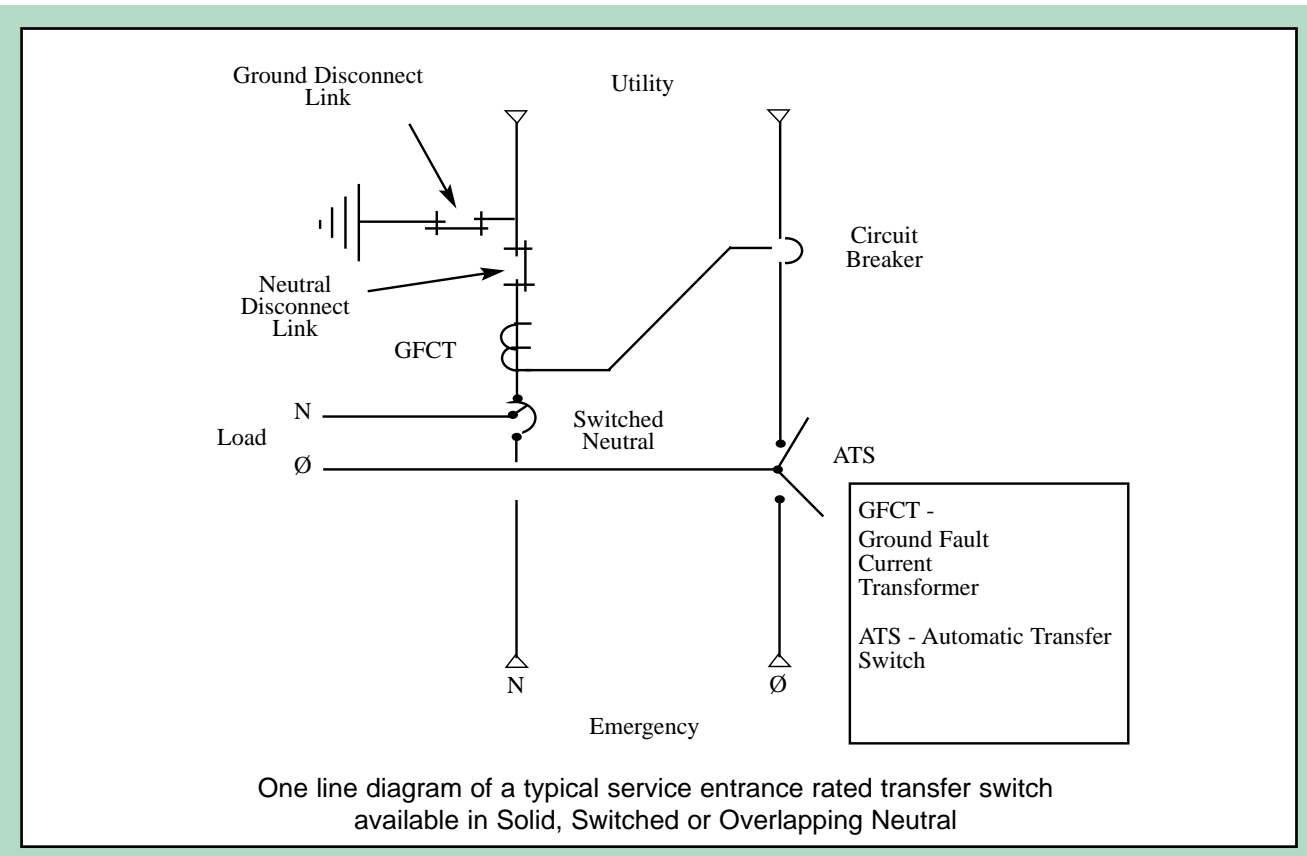

### Standard Features

- Available from 150 to 4000 amperes
- ASCO 7000 Series Power Transfer Switch, UL 1008 Listed
- Standard UL Type 1 Enclosure
- Disconnect and overcurrent protective device on the utility source: molded case circuit breaker 150 to 800 Amp; insulated case 1000 to 4000 Amp
- Disconnect link on Neutral
- Disconnect link on Ground
- Ground and Neutral Bus, all silver-plated copper
- Solderless screw type terminals for External Power Connections
- Labeled UL 891, meets all NEC requirements for service entrance
- Internet Enabled Command and control available with optional ASCO SiteWeb™
- Ground fault circuit protection on utility breaker when required by NEC.

### Optional Features

- Enclosures - Secure Double Door
  - ◆ UL Type 3R w/strip heater & thermostat
  - ◆ UL Type 4X
  - ◆ UL Type 12
- Connections
  - ◆ Crimp lugs
  - ◆ Bus Riser on Normal, Emergency or Load
- Protective Relays/Metering
  - ◆ ASCO 5200 Series Power Manager Xp
- Surge Suppression
  - ◆ ASCO 451, 80KA Surge protector
- Communications
  - ◆ ASCO 72A Communication interface module
  - ◆ ASCO PowerQuest® VPi
  - ◆ ASCO 5500 Series Thin Web Server for internet connection

*Consult ASCO for additional features*

### Dimensions and Weights

Switch Rating amps	Width inches (mm)	Height inches (mm)	Depth inches (mm)	Weight lbs (kg)
150	30 (762)	31.125 (791)	12 (305)	390 (177)
260, 400	32 (813)	50.25 (1276)	13 (330)	400 (182)
600, 800	38 (965)	91 (2311)	28 (711)	800 (363)
1000-2000	38 (965)	91 (2311)	48 (1219)	2590 (1176)
3000	38 (965)	91 (2311)	60 (1524)	5500 (2497)
4000	46 (1168)	91 (2311)	72 (1829)	6900 (3133)



**GeneratorJoe**

4016 Quartz Drive  
 Santa Rosa, CA 95405  
 Phone: 707 539-9003  
 Fax: 707 539-5212  
 Email: sales@generatorjoe.NET  
 Web www.generatorjoe.NET





Fig. 9: 7000 Series Microprocessor Controller.

The 7000 Series Microprocessor Based Controller is used with all sizes of Power Transfer Switches from 30 through 4000 amperes. It represents the most advanced digital controller in the industry and includes, as standard, all of the voltage, frequency, control, timing and diagnostic functions required for most emergency and standby power applications.

Because of severe voltage transients frequently encountered with industrial distribution systems, the microprocessor logic board is separated and isolated from the power board as shown below. This improves electrical noise immunity performance and helps assure compliance with the rigorous transient suppression standards highlighted below.

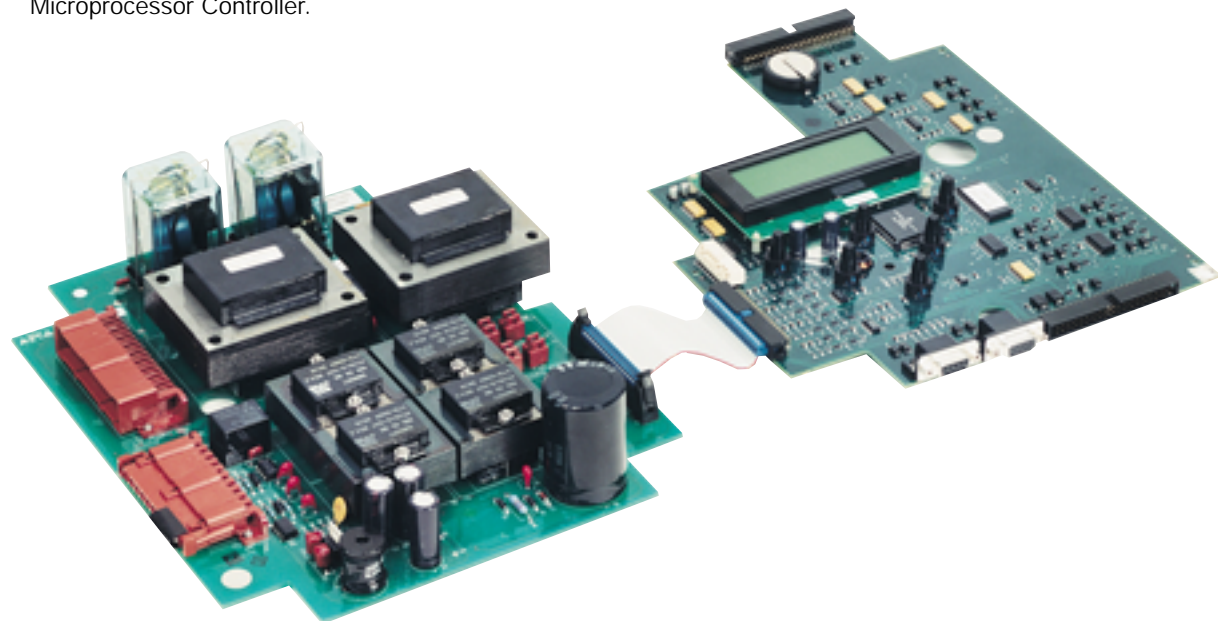


Fig.10: Microprocessor Power and Logic PC Boards.

7000 Series Microprocessor Based Controller	
Emission Standard - Group 1, Class A	EN 55011:1991
Generic Immunity Standard, from which:	EN 50082-2:1995
Electrostatic Discharge (ESD) Immunity	EN 61000-4-2:1995
Radiated Electromagnetic Field Immunity	ENV 50140:1993
Electrical Fast Transient (EFT) Immunity	EN 61000-4-4:1995
Surge Transient Immunity	EN 61000-4-5:1995
Conducted Radio-Frequency Field Immunity	EN 61000-4-6:1996
Voltage Dips, Interruptions and Variations Immunity	EN 61000-4-11:1994

### Features

- Digital microprocessor.
- Touch pad programming of features and settings without the need for meters, or variable power supplies.
- Sixteen (16) selectable operating voltages available in a single Controller.
- On-board diagnostics provide control panel and ATS status information to analyze system performance.
- Displays and counts down active timing functions.
- Selectable multi-language display (English, German, Spanish, or French. For others contact ASCO).
- Password protection to prevent unauthorized tampering of settings.
- Serial communications board (RS-485 protocol) for remote monitoring and control with ASCO PowerQuest® VPi and SiteWeb™ communications products. Specify optional accessory 72A.
- Load shed option for SYNCHROPOWER® bus optimization applications. Specify optional accessory 30B.

### Voltage and Frequency Sensing

- 3-Phase under and over voltage settings on normal and emergency sources.
- Under and over frequency settings on normal and emergency.
- True RMS Voltage Sensing with +/- 1% accuracy; Frequency Sensing Accuracy is +/- 0.2%.
- Selectable settings: single or three phase voltage sensing on normal and emergency; 50 or 60Hz.
- Phase sequence sensing for phase sensitive loads.
- Voltage unbalance detection between phases.

### Status and Control Features

- Output contact (N/O or N/C) for engine-start signals.
- Selection between "commit/no-commit" on transfer to emergency after engine start and normal restores before transfer.
- Advanced inphase algorithm which automatically measures the frequency difference between the two sources and initiates transfer at appropriate phase angles to minimize disturbances when transferring motor loads.
- Event log displays 99 logged events with the time and date of the event, event type and event reason.
- Output signals for remote indication of normal and emergency source acceptability
- Statistical ATS/System monitoring data screens which provide:
  - Total number of ATS transfers.
  - Number of ATS transfers caused by power source failure.
  - Total number of days ATS has been in operation.
  - Total number of hours that the normal and emergency sources have been available.

### Time Delays

- Engine start time delay - delays engine starting signal to override momentary normal source outages - adjustable 0 to 6 seconds.
- Transfer to emergency time delay - adjustable 0 to 60 minutes.
- Emergency source stabilization time delay to ignore momentary transients during initial generator set loading - adjustable 0 to 6 seconds.
- Retransfer to normal time delay with two settings:
  - Power failure mode - 0 to 60 minutes.
  - Test mode - 0 to 60 minutes.
- Unloaded running time delay for engine cooldown - adjustable 0 to 60 minutes.
- Pre and post transfer signal time delay for selective load disconnect with a programmable bypass on source failures - adjustable 0 to 5 minutes. This signal can be used to drive a customer furnished relay, or for (2) sets of double throw contacts rated 3 amps at 480 volts AC, specify ASCO optional accessory 31Z.
- Fully programmable engine exerciser with seven independent routines to exercise the engine generator, with or without loads, on a daily, weekly, bi-weekly or monthly basis.
- Contains all alarm signals, logic and time delays for use with closed transition switches.
  - Insynch time delay - 0 to 3 seconds.
  - Failure to synchronize - 1 to 5 minutes.
  - Extended parallel - 0.1 to 1.0 seconds.
- Delayed transition load disconnect time delay - adjustable 0 to 5 minutes.



4016 Quartz Drive  
 Santa Rosa, CA 95405  
 Phone: 707 539-9003  
 Fax: 707 539-5212  
 Email: sales@generatorjoe.NET  
 Web www.generatorjoe.NET

### Control Switches and Indicating Lights for Conventional 2-Position Switches

- Switch position indicating lights (16 mm, industrial grade LEDs).
- Source acceptability indicating lights with true indication of the acceptability of each source, as determined by the voltage, frequency, voltage unbalance, and phase sequence settings of the control panel (16mm, industrial grade LEDs).
- Three position (16mm, industrial grade type) selector switch:
- Automatic: Normal maintained position.
- Test: Momentary position to simulate normal source failure for system test function.
- Reset Delay Bypass: Momentary position to bypass transfer and re-transfer time delay.



Fig. 11: 7000 Series User Controls and Indicators.

### Control Switches and Indicating Lights for Closed Transition Switches



Fig. 12: 7000 Series User Controls and Indicators.

- **Extended Parallel Time** - Provides visual indication when the pre-set extended parallel time has been exceeded. The controls automatically open the emergency or normal main contacts. Separate contact also available to shunt trip external breaker.
- **Failure To Synchronize** - Visually displays a failure to synchronize alarm if the time delay settings is exceeded, during closed transition transfer operation.
- **TS Locked Out** - Prevents transfer in either direction if the extended parallel time is exceeded.
- **Alarm Reset** - Resets extended parallel and failure to synchronize alarms.
- **Closed Transition Bypass** - Pushbutton allows transfer between sources in an open transition mode.

### 7000 Series Transfer Control Center



Fig. 13: 7000 Series Transfer Control Center.

The 7000 Series microprocessor controller is a Transfer Control Center which allows the user to easily access detailed information on: system status; power source parameters; voltage, frequency and time delay settings; optional feature settings; historical event log; and system diagnostics. A four line, (20) character LCD has a backlit display which enables easy viewing under all conditions. The user can navigate through all screens using only six buttons, which also allows selection of: (18) different source parameter settings; (16) standard time delays; (12) standard feature settings; up to seven independent engine exercise routines; and even the language (English, German, Spanish, French, etc.) which appears on the display.

Since the Transfer Control Center must be visible and operable through the enclosure door, it has been qualified for use in industrial and outdoor applications. This includes installation in Type 3R (outdoor/rainproof), 4 (weatherproof) and 12 (indoor/industrial) enclosures.



### Status

<p><b>System Status</b></p> <p>Normal OK Load on Normal</p> <p>Displays system status in clear, concise language. Message shown indicates normal source is acceptable and the load is connected to the normal source.</p>	<p><b>Source Status</b></p> <p>Normal Source Vab=480V.....ABC Vbc=480V.....Vunbal=1% Vca=480V.....60.0Hz</p> <p>Displays voltage for each phase, frequency, phase rotation and voltage unbalance for both normal and emergency sources.</p>
<p><b>Time Delay Status</b></p> <p>Normal OK TD.Engine.Cooldown: 4min15s</p> <p>Active time delay status displays time remaining until next control event.</p>	<p><b>Inphase Transfer Mode</b></p> <p>Emerg OK Waiting for In-Sync -45o 0.02Hz</p> <p>Displays the relative phase angle between sources and frequency differential to indicate the controller is awaiting an inphase condition.</p>

### Settings

<p><b>Voltage and Frequency Settings</b></p> <p>Normal Voltage Dropout.....85%.408V Pickup.....90%.432V O.V. Trip.....110%.528V</p> <p>Provides voltage and frequency setting values for normal and emergency sources. Voltage pick-up, dropout and trip settings are set in percentage of nominal voltage and are also displayed in rms voltage values.</p>	<p><b>Time Delay Settings</b></p> <p>TD N&gt;E Xfer Signal Bypass if N Fail: No Pre Xfer: 0 min 20S Post Xfer: 0 min 20S</p> <p>Provides direct reading display for setting time delays.</p>
<p><b>Engine Exerciser</b></p> <p>P1.....Engine.Exerciser Enable:.....Yes....WLoad:....Yes Start:19h30. ALL MON Run.Time:.....2h15min</p> <p>Seven independent programs, load/no load selection, flexible run times and daily, weekly, bi-weekly and monthly exercise routines.</p>	<p><b>Feature Settings</b></p> <p>Shed Load Direction: From E Inphase: No TD/0.25</p> <p>Standard features can be activated with the keypad. As an example, when enabled, the "shed load" option causes the transfer switch to transfer the load off of the specified source. If desired, the load shed transfer can be made inphase.</p>

### Data Logging

<p><b>ATS Statistics</b></p> <p>ATS Statistics ATS Total Xfers: 46 SRC Fail Tot Xfers: 20 Days Energized: 36.5</p> <p>Instant availability of statistical information on total number of ATS transfers, number of transfers caused by power failures and total days controller has been energized, plus more.</p>	<p><b>Historical Event Log</b></p> <p>16.AUG02/95.....13h10:17 Eng.Start.....NormFail. 15.AUG02/95.....13h10:25 Xfer.N&gt;E.....</p> <p>Displays detailed information for last 99 events, including time of occurrence, length of event, date and reason for event.</p>
---	---



**Time Delays**

**2C** The standard feature one time delay is adjustable from 0 to six seconds to delay engine starting. If necessary, extended time delay on engine starting is available. Adjustable from 0 to 60 min in one second steps. Factory set at five minutes.

**Manual Controls for Automatic Transfer Switches**

**6C** Reset switch for manual retransfer to normal with automatic retransfer in the event of emergency source failure.

**6D** Selector switch for automatic/manual retransfer to normal. Automatic bypass if emergency fails.

**Engine Generator Controls and Accessories**

**12** Three position engine control selector switch. Positions: 1- Stop 2- Automatic 3- Engine Test

*Note: Switches with accessory 12 must be labelled as a non-automatic transfer switch according to UL 1008.*

*Engine controls containing "engine stop" positions should be located at the engine generator. (Consult ASCO for application assistance.)*

**Indicators**

**14A/14B** Additional auxiliary contact sets to indicate switch position. Two sets are standard. Specify total number of sets if more are required.

**18B** Two-pole, double-throw contacts operate when emergency source voltage is present at transfer switch terminals.

**18G** Two-pole, double-throw contacts operate when normal source voltage is present at transfer switch terminals.

**99** "Push-to-Test" feature on all pilot light indicators.

**Customer Control Circuits**

**30A** Load-shedding circuit initiated by opening of a customer-supplied contact.

**30B** Load-shedding circuit initiated by removal of customer-supplied control voltage. (Specify voltage).

**31Z** Selective load disconnect control contacts (two provided) which operate with time delay prior to and/or after load transfer and retransfer.

**43R** Terminal block for all customer control connections on 30-150 amp only (standard on all other sizes).

**Neutral Conductor Options**

- Solid neutral, with fully-rated terminals. (AL-CU) UL Listed.
- Conventional neutral switching pole.
- Overlapping neutral transfer contacts. Allows for proper ground-fault sensing and avoids generator voltage transients during transfer.

*Note: Specify neutral option in catalog number, see page 21 for instructions.*

**Extension Harness**

**37B** Six foot (6') extension harness to increase distance between transfer switch and control panel on open-type units.

**Analog Load Metering Options**

**23B** Three phase ammeter with selector switch (with current transformers and shorting blocks).

**24B** Three phase voltmeter with selector switch.

*Note: Refer to ASCO 7000 Series Data Monitor on page 15 which provides voltage, frequency and power monitoring.*

**Serial Communications**

**72A** Serial communication module for remote communications to ASCO PowerQuest® VPI products.

**Surge Protection**

ASCO Pulsar 450 rated 40KA

**73AC1** Normal source protection. (3Æ, 4wire WYE)

**73AC2** Emergency source protection. (3Æ, 4wire WYE)

**73AC3** Load side protection. (3Æ, 4wire WYE)

*Note: Other distribution voltages available (Contact ASCO).*

**Bypass Isolation Switch Options**

**14A1** Auxiliary contact to close in "Bypass to Normal" position.

**14B1** Auxiliary contact to close in "Bypass to Emergency" position.

**14T** Auxiliary contact to close when transfer switch is in "Automatic" position.

**14U** Auxiliary contact to close when transfer switch is in "Isolate" position.

**14V** Auxiliary; contact to close when transfer switch is in "Test" position.

**ATS Bypass Isolation Drawout Features**

(1000-3000 amperes)

**82B** Transfer switch lifting yoke to facilitate the removal of the transfer switch from the drawout carriage.

**82C** Automatic shutters to provide isolation of bus stabs.

*Note: An externally operable quick-make, quick-break (OMQB), manual handle is available on some 7000 Series product configurations. (Consult ASCO for guidance.)*

**ASCO Power Manager**

The ASCO Power Manager (formerly Data Monitor) is a microprocessor based metering device that provides real-time measurements of single and three phase power systems. The Power Manager uses digital signal processing technology to measure voltage and current per phase; real, reactive and apparent power, and bi-directional energy. All measurements can be viewed locally with a backlit liquid crystal display and/or displayed remotely with ASCO PowerQuest® VPI or SiteWeb™ products.

Direct voltage input for systems up to 600 Volts AC can be monitored without the use of external potential transformers (PTs). Measures three phase currents and a fourth current input is available for measuring current in the neutral conductor. The Power Manager includes one discrete input for transfer switch position, eight general purpose discrete inputs, and four relay outputs for controlling or monitoring external devices.

**Power Metering**

- Voltage:
  - Line - Line: VAB, VBC, VCA, VAVERAGE
  - Line - Neutral: VAN, VBN, VCN, VAVERAGE
- Frequency: 45.0 to 66.0 Hertz
- Current: IA, IB, IC, IAVERAGE
- Unbalance %: Voltage, Amps
- Real Power: KWA, KWB, KWC, KWNET
- Reactive Power: KVARA, KVARB, KVARC, KVARNET
- Apparent Power: KVAA, KVAB, KVAC, KVANET
- Real Energy: KWHIMPORT, KWHEXPORT, KWHNET
- Reactive Energy: KVARHIMPORT, KVARHEXPORT, KVARHNET
- Power Factor: PFA, PFB, PFC, PFNET

**Data Access**

- Eight digital inputs, four relay outputs.
- Input/Output 15-character, user definable screen display for identification of input/output signals.



**GeneratorJoe**

*Note: The ASCO Power Manager is also available as a separate unit for monitoring electrical parameters anywhere in the power distribution system.*

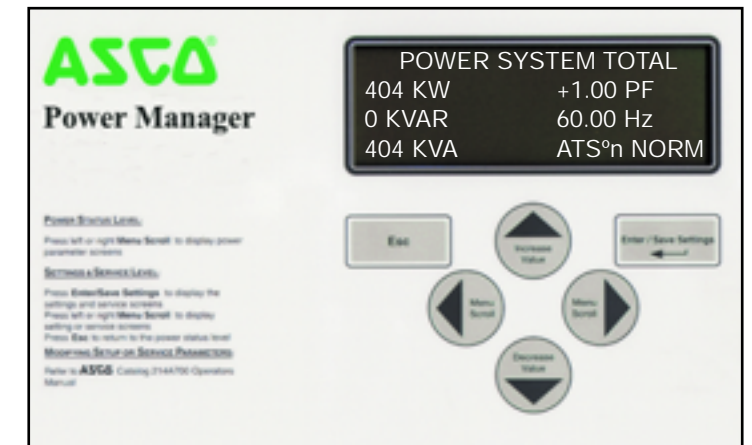


Fig. 14: ASCO Power Manager.

**Configurable Designations**

- Local - A four line 20 character LCD backlit display.
- Remote - With optional Acc. 72A communication module and Power Manager monitoring systems.
- Provides a user programmable setpoint based on watt demand and can be used to control one of the four relay outputs. Used for peak shaving applications

**Integrated ATS Features**

- When configured on load of ATS:
  - Displays ATS position.
  - Displays power data as a function of ATS position (normal/emergency).
  - Accumulates energy data separately for normal and emergency sources.

Optional Configurations and Connection Arrangements		
Connected To:	With Display	Without Display
Load	Acc. 85L	Acc. 75L
Normal	Acc. 85N	Acc. 75N
Emergency	Acc. 85M	Acc. 75M
Load (BPS only)	Acc. 85R*	Acc. 75R*

*Add suffix "A" to above designations if neutral conductor monitoring is required.*


*Note: Accessory 75 and 85 includes component mounting, CTs, shorting blocks and all necessary interwiring.*

*\* Bypass & isolation switch contacts wired to discrete power manager inputs.*



### ASCO Connectivity Solutions

ASCO PowerQuest® VPi and SiteWeb™ communications products allow for the monitoring and control of power transfer switches in your Emergency or Standby Power Distribution System. Local Area networks and Remote networks are supported with either single or multiple points of access, and web-enabled communications allow access to your power system from anywhere around the world.

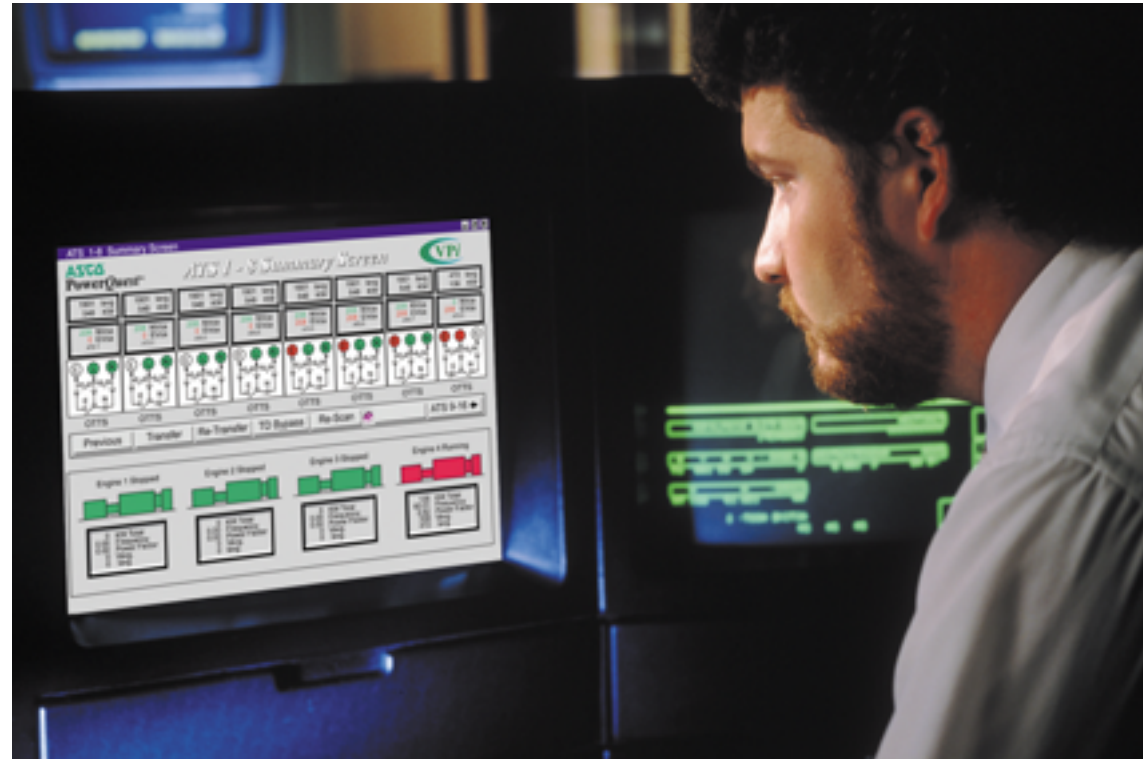

### Features

- Monitors and Controls Power Transfer Switches and Engine Generators
- Monitors Normal and Emergency Voltages and Frequency
- Indicates Transfer Switch Position and Source Availability
- Provides Transfer and Retransfer of Loads for System Testing
- View Normal and Emergency Voltage and Frequency Settings
- View Transfer Switch Time-Delay Settings
- Provides Transfer Switch Rating and Identification
- Automatic paging notifies personnel, by e-mail or pager, of selected system alarms
- View current, power and power factor with ASCO Power Managers connected to the system
- Adjust and set transfer switch controller parameters
- Activate transfer switch control functions, such as inphase transfer, selective load disconnect time displays and engine exerciser programming
- View Transfer Switch Event Log
- Provides Transfer Switch Test Schedule



**GeneratorJoe**

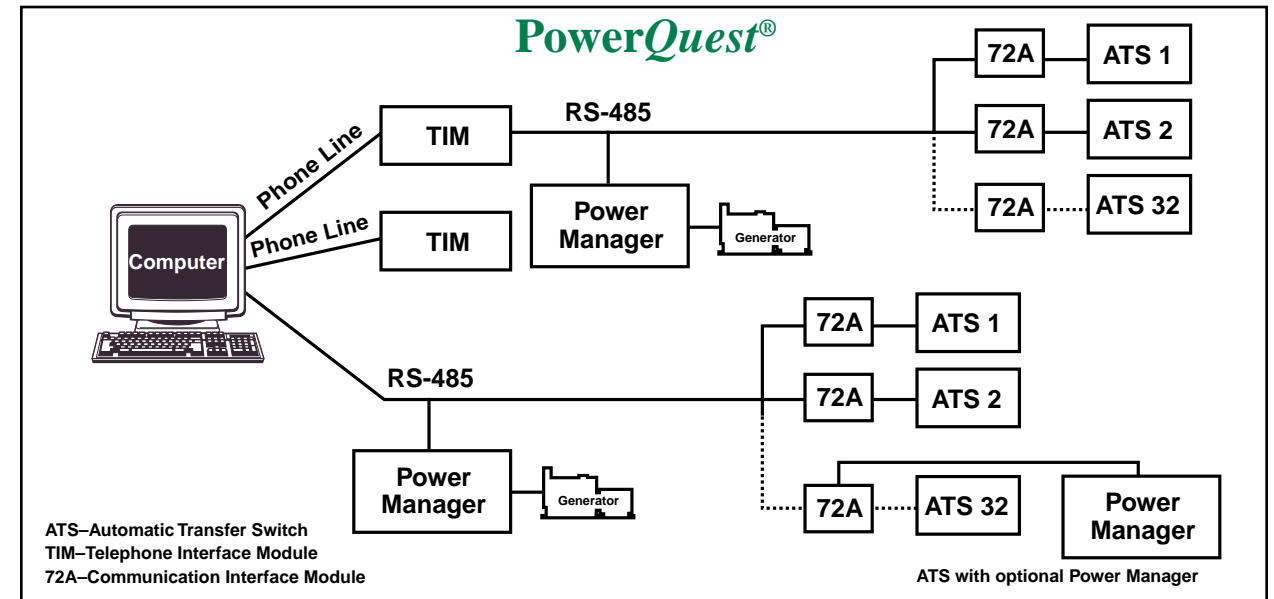


Fig. 15

PowerQuest® VPi is a PC based software package. When combined with the ASCO Communication Interface Module (Acc 72A), the ASCO 5120 Telephone Interface Module and ASCO 5200 Series Power Manager, as shown above, it provides the most economical communication system for monitoring and control of power transfer switches and engine generators.

The local RS-485 network allows communications with up to 32 power transfer switches and four engine generators. An analog phone connection and ASCO telephone interface module allow for direct dial up, monitoring and control of remote locations. The ASCO Power Manager not only allows you to view current power and power factor readings, but also has a programmable KW set point to initiate transfer of loads to a standby source for peak shaving operations.

### Communication Interface Module (Acc 72A)

Communication Interface Module to allow local, remote or web-enabled communications with ASCO PowerQuest® VPi or SiteWeb™ communication products. An accessory 72A is required on each power transfer switch.



Fig. 16: Communication Interface Module




Fig. 17: Telephone Interface Module

### 5100 Series Telephone Interface Module (for use with PowerQuest® VPi)

The ASCO Telephone Interface Module (TIM) allows users to dial directly into their ASCO communications network for monitoring and/or control. The TIM connects to the ASCO communication network via RS-485 and the phone port connects directly into an analog phone jack. Also, the TIM has an RS-232 connector which allows the TIM to be used as the dialing modem.

Supplied with 120 VAC to 18 VDC (nominal) UL approved, class 2 power supply.

Summary Screen



Convenient One-Line Diagram

- Colored icons highlighted to show source availability and which source is connected to load.
- Contacts move on icon to indicate main contact position of transfer and bypass switch. (Automatic transfer and automatic transfer and bypass isolation switches must be provided with optional accessory 14 auxiliary contacts shown on page 14.)
- Bypass switch contacts appear on icon when configured by user input data.

GeneratorJoe



Power Manager Detail Screen

- Voltage: phase to phase; phase to neutral and voltage unbalance.
- 3 phase currents and neutral (optional).
- Frequency.
- Kilowatt hours - normal and emergency.
- Status and control of four relay outputs.
- Status of eight digital inputs.
- Device ratings: CT and PT ratio.


Transfer Switch Detail Screen

- ATS rating and identification data is displayed.
- Allows remote testing and time delay bypass.
- Voltage, frequency, phase sequence, voltage unbalance and time delay settings can be checked.
- Viewing of engine exercise schedules.
- Displays phase to phase voltage on normal and emergency.
- Provides complete system status message from 7000 series microprocessor controller.
- View event log on the last 99 events for each ATS.
- Arrange test schedules for transfer switches.
- Provides for monitoring of local site or remote sites.

Engine-Generator Details

- Voltage: Phase to phase; Phase to neutral
- Current for each phase.
- Kilowatts and kilowatt hours total.
- Frequency and power factor.
- Status and control of four digital outputs which can be customized by the user.
- Status of eight digital inputs.
- "Alarm Enabled" selection. These alarms flash the "engine-generator" icon on the summary screen.
- Digital inputs for engine malfunctions are derived from engine mounted sensors (supplied by others).



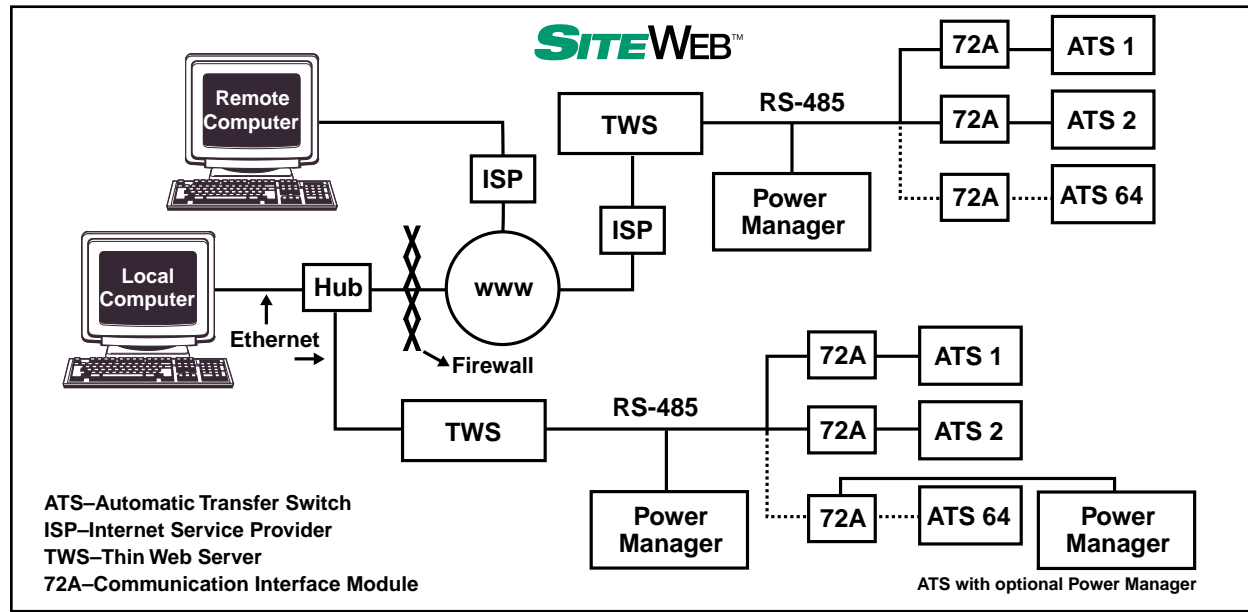

SiteWeb™ is a client-server application requiring no software to be installed on the client computer. When combined with the ASCO Communication Interface Module (Acc 72A), the ASCO 5500 Series Thin Web Server and the ASCO 5200 Series Power Manager, as shown above, it provides the most comprehensive Intranet and Internet communication system for the monitoring and control of power transfer switches and engine generators located in your emergency or standby power distribution system.

The SiteWeb™ communication system allows multiple client access, from local or remote locations, and provides for the monitoring of up to 64 power transfer switches and eight engine generators. In addition, automatic paging is provided for all alarm signals. SiteWeb™ is available to provide monitoring and control to building automation systems incorporating modbus networks via ethernet, serial and modem interfaces.



Fig. 18: Thin Web Server

### 5500 Series Thin Web Server (for use with SITEWEB™ products)

The ASCO Thin Web Server allows you to monitor and control transfer switches and engine generators anytime over the Internet or an Intranet from anywhere in the world. It also transmits a page message that an alarm has occurred with one or more of the transfer switches. Plus, this is possible from your home computer or anywhere that has Internet service, using the ASCO Thin Web Server single-board computer with its embedded SiteWeb™ HTML web pages.

### PowerQuest® VPi vs. SITEWEB™

	PowerQuest® VPi	SITEWEB™
Number of Monitored/Controlled Power Transfer Switches	32	64
Number of Monitored/Controlled Gensets	4	8
Web Access	No	Yes
Monitor Multiple Sites	Yes	Yes
Multiple Client Access	No	Yes
Client Software Required	Yes	No
Email / Paging upon Alarms	No	Yes
Modbus Interface (Serial & TCP/IP)	No	Yes

To order an ASCO 7000 Series Power Transfer Switch, complete the following catalog number:

7 A TS + A + 3 + 400 + N + 5X + C

	Product	Neutral Code*	Phase Poles	Amperes	Voltage Code	Grp Code	Enclosure
A	Automatic	TS	Conventional 2-Position	30	1000	A	No enclosure
			Open Transition Bypass	70	1200	B	Type 1 enclosure
				100	1600	C	Type 2 enclosure
N	Non-Automatic	CTS	Closed Transition	150	2000	D	Type 3R enclosure
			Closed Transition Bypass	260	3000	E	Type 4 enclosure
				400	4000	F	Type 4X enclosure (stainless steel)
M	Manually Operated	DTS	Delayed Transition	600	4000	J	Type 7 enclosure
				800		K	Type 12 enclosure
						L	Type 3R secure double door
			Delayed Transition Bypass			M	Type 4 secure double door
						N	Type 4X secure double door
						Q	Type 12 secure double door

\*Note: Switches rated 30-150, 600-3000 amps available with 2, 3 or either conventional switched neutral (4 poles) or overlapping neutral (optional). For 4 pole applications on switches rated 260 to 400 amps and 4000 amps specify overlapping switched neutral (optional). Conventional switch neutral is provided on delayed transition transfer products when specified.

The Example Catalog Number above is 7ATSA3400N5XC (X is used to specify optional accessories).

### Transfer Switch Configurations

7A TS, 7N TS, 7A DTS, 7A CTS, 7N DTS, 7N CTS

### Sizes of UL-Listed Solderless Screw-Type Terminals for External Power Connections

Switch Rating amps	Max # of Conductors per Terminal	Range of AL-CU Conductor Sizes
30, 70, 100	One	# 14 to 2/0 AWG
150	One	#8 to 3/0 AWG
260-400	One	#4 AWG to 600 MCM
	Two	#1/0 AWG to 250 MCM
600	Two	#1/0 AWG to 600 MCM
800-1200 <sup>1</sup>	Four	#1/0 AWG to 600 MCM
1600-2000	Six	#1/0 AWG to 600 MCM
3000	Twelve	#1/0 AWG to 600 MCM
4000 <sup>2</sup>	Suitable for Bus Bar Connection or Lugs Can Be Field Modified	

Notes: 1. Unit is designed for top cable entry of emergency and load and bottom entry of normal. Optionally, the switch may be supplied with reverse source and/or bottom entry load, when specified.

2. All main terminals are rear connected. The 4000 amp switch is arranged for bus bar connection. Contact ASCO if provisions for cable connection are required.

### Transfer/Bypass Configurations

7A TB, 7N TB, 7A DTB, 7A CTB, 7N DTB, 7N CTB

### Sizes of UL-Listed Solderless Screw-Type Terminal for External Power Connections

Switch Rating amps	Max # of Conductors per Terminal	Range of AL-CU Conductor Sizes
150,260,400	One	# 4 AWG to 600 MCM
	Two	# 1/0 AWG to 250 MCM
600-800	Three	# 2 AWG to 600 MCM
1000-1200 <sup>1</sup>	Four	# 1/0 AWG to 600 MCM
1600-2000 <sup>1</sup>	Six	# 1/0 AWG to 600 MCM
3000 <sup>1</sup>	Ten	# 2 AWG to 600 MCM
4000 <sup>1</sup>	Twelve	# 2 AWG to 600 MCM

Notes: 1. All main terminals are rear connected.

2-Position Transfer Switching 7A TS, 7N TS (Non-Bypass)

Switch Rating amps	Poles	Width inches (mm)	Height inches (mm)	Depth inches (mm)
<b>Enclosed UL Type 1<sup>2</sup></b>				
30, 70, 100, 150	2, 3 or 3 with neutral B/C	18 (457)	48 (1219)	13 (330)
260, 400	2, 3 or 3 with neutral C	22 (559)	48 (1219)	13 (330)
600, 800, 1000	2, 3 or 3 with neutral B/C	34 (864)	72 (1829)	20 (508)
1200	2, 3 or 3 with neutral B/C	38 (965)	87 (2210)	23 (584)
1600, 2000 <sup>1</sup>	2, 3 or 3 with neutral B/C	38 (965)	91 (2311)	48 (1219)
3000 <sup>1</sup>	2, 3 or 3 with neutral B/C	38 (965)	91 (2311)	60 (1524)
4000 <sup>1</sup>	2, 3 or 3 with neutral C	46 (1168)	91 (2311)	72 (1829)
<b>Open Configuration</b>				
30, 70, 100, 150	2, 3 or 3 with neutral B/C	10-1/4 (260)	10-1/4 (260)	5-1/2 (140)
260, 400	2 or 3	12 (305)	18-1/2 (470)	6-7/8 (175)
260, 400	2 or 3 with neutral C	14-1/2 (368)	18-1/2 (470)	6-7/8 (175)
600, 800, 1000, 1200	2, 3 or 3 with neutral B/C	27 (686)	31 (787)	12-7/8 (327)
1600, 2000	2, 3 or 3 with neutral B/C	33-1/4 (845)	28 (711)	26-1/4 (667)
3000	2, 3 or 3 with neutral B/C	33-1/4 (845)	28 (711)	30-3/4 (781)
4000	2, 3 or 3 with neutral C	41 (1041)	52 (1321)	25-1/2 (648)

Notes: 1. Enclosures for 1600 - 4000 amp are free-standing with removable top, sides, and back.  
2. Consult ASCO for dimensions on enclosures other than UL type 1.

**Shipping Weights**

2-Position Transfer Switching 7A TS, 7N TS

Switch Rating amps	Poles	Enclosed lb (kg)	Open lb (kg)*
30, 70, 100	2	67 (31)	15 (7)
30, 70, 100	3	70 (32)	18 (8)
30, 70, 100	3 with B/C	73 (33)	21 (10)
150	2	69 (32)	17 (8)
150	3	72 (33)	20 (9)
150	3 with B/C	75 (34)	23 (11)
260, 400	2	117 (53)	37 (17)
260, 400	3	125 (57)	45 (21)
260, 400	3 with C	133 (61)	53 (24)
600, 800, 1000	2	400 (182)	150 (68)
600, 800, 1000	3	420 (192)	170 (78)
600, 800, 1000	3 with B/C	446 (203)	196 (90)
1200	2	685 (312)	150 (68)
1200	3	705 (321)	170 (78)
1200	3 with B/C	731 (333)	196 (90)
1600, 2000	2	1110 (503)	370 (167)
1600, 2000	3	1160 (525)	420 (190)
1600, 2000	3 with B/C	1210 (548)	470 (213)
3000	2	1365 (620)	405 (184)
3000	3	1430 (649)	470 (213)
3000	3 with B/C	1495 (679)	535 (243)
4000	2	2208 (1002)	975 (443)
4000	3	2433 (1104)	1200 (545)
4000	3 with C	2533 (1149)	1300 (590)

Notes: \*Open weights include transfer switch and control panel.  
1200-4000 amp enclosures require ventilation openings, refer to drawings for details.  
Export shipments may require a wooden box, contact ASCO for weights and dimensions.

Closed Transition and Delayed Transition Transfer Switching  
7A DTS, 7A CTS, 7N DTS, 7N CTS

Switch Rating amps	Poles	Width inches (mm)	Height inches (mm)	Depth inches (mm)
<b>Enclosed UL Type 1<sup>3</sup></b>				
150, 260, 400 <sup>1</sup>	2, 3 or 3 with neutral C	24 (610)	63 (1600)	17-1/2 (445)
600, 800, 1000	2, 3 or 3 with neutral B	34 (864)	72 (1829)	20 (508)
1200	2, 3 or 3 with neutral B	38 (965)	87 (2210)	23 (584)
1600, 2000 <sup>2</sup>	2, 3 or 3 with neutral B	38 (965)	91 (2311)	48 (1219)
3000 <sup>2</sup>	2, 3 or 3 with neutral B	38 (965)	91 (2311)	60 (1524)
4000 <sup>2</sup>	2, 3 or 3 with neutral C	46 (1168)	91 (2311)	72 (1829)
<b>Open Configuration</b>				
150, 260, 400	2, 3 or 3 with neutral C	14-3/4 (375)	30 (762)	5-7/8 (149)
600, 800, 1000, 1200	2, 3 or 3 with neutral B	27 (686)	31 (787)	12-7/8 (327)
1600, 2000	2, 3 or 3 with neutral B	33-1/4 (845)	28 (711)	26-1/4 (667)
3000	2, 3 or 3 with neutral B	33-1/4 (845)	28 (711)	30-3/4 (781)
4000	2, 3 or 3 with neutral C	41 (1041)	52 (1321)	29-1/2 (749)

Notes: 1. For 400 amp, 7A DTS and 7N DTS with neutral code B; dimensions are 34 (864) X 72 (1829) x 20 (508).  
2. Enclosures for 1600 - 4000 amp are free-standing with removable top, sides, and back.  
3. Consult ASCO for dimensions on enclosures other than UL type 1

**Shipping Weights**

Closed Transition and Delayed Transition Transfer Switching  
7A DTS, 7A CTS, 7N DTS, 7N CTS

Switch Rating amps	Poles	Enclosed lb (kg)	Open* lb (kg)
150, 260, 400	2	137 (62)	45 (21)
150, 260, 400	3	145 (66)	53 (24)
150, 260, 400	3 with C	153 (69)	63 (28)
600, 800, 1000	2	420 (192)	175 (80)
600, 800, 1000	3	450 (205)	205 (94)
600, 800, 1000	3 with B	480 (219)	235 (108)
1200	2	710 (324)	175 (80)
1200	3	740 (337)	205 (94)
1200	3 with B	770 (351)	235 (108)
1600, 2000	2	1300 (590)	505 (229)
1600, 2000	3	1350 (612)	555 (252)
1600, 2000	3 with B	1400 (635)	605 (274)
3000	2	1555 (706)	540 (245)
3000	3	1620 (735)	660 (300)
3000	3 with B	1685 (765)	725 (329)
4000	2	2360 (1071)	1127 (511)
4000	3	2580 (1171)	1347 (611)
4000	3 with C	2680 (1217)	1447 (657)

Notes: \*Open weights include transfer switch and control panel.  
1600-4000 amp enclosures require ventilation openings, refer to drawings for details.  
Export shipments may require a wooden box, contact ASCO for weights and dimensions.



4016 Quartz Drive  
Santa Rosa, CA 95405  
Phone: 707 539-9003  
Fax: 707 539-5212  
Email: sales@generatorjoe.NET  
Web www.generatorjoe.NET



Automatic Transfer Bypass-Isolation Switching  
with Transfer Switch Engaged 7A TB, 7N TB

Switch Rating amps	Poles	Width inches (mm)	Height inches (mm)	Depth inches (mm)
<b>Enclosed UL Type 1</b>				
150, 260, 400 <sup>1</sup>	2, 3 or 3 with neutral C	28-1/2 (724)	62-1/2 (1588)	19 (483)
600, 800 <sup>2</sup>	2, 3 or 3 with neutral B/C	36 (914)	90 (2286)	22 (559)
1000, 1200 <sup>3</sup>	2, 3 or 3 with neutral B/C	38 (965)	91 (2311)	60 (1524)
1600, 2000 <sup>3</sup>	2, 3 or 3 with neutral B/C	38 (965)	91 (2311)	60 (1524)
3000 <sup>3</sup>	3 or 3 with neutral B/C	38 (965)	91 (2311)	72 (1829)
4000 <sup>4</sup>	3 or 3 with neutral C	96-1/2 (2451)	91 (2311)	72 (1829)
<b>Open Configuration</b>				
150, 260, 400 <sup>1</sup>	2 or 3	14-3/4 (375)	37-1/8 (946)	22-1/4 (565)
150, 260, 400 <sup>1</sup>	2 or 3 with neutral C	19-3/4 (500)	61-1/2 (1553)	22-1/4 (565)
600, 800 <sup>2</sup>	2 or 3	23-3/4 (603)	67-1/4 (1708)	24-3/4 (629)
600, 800 <sup>2</sup>	2, 3 or 3 with neutral B/C	27-1/4 (692)	67-1/4 (1708)	24-3/4 (629)
1000, 1200 <sup>3</sup>	2, 3 or 3 with neutral B/C	38 (965)	72 (1829)	38 (965)
1600, 2000 <sup>3</sup>	2, 3 or 3 with neutral B/C	38 (965)	72 (1829)	38 (965)

- Notes: 1. Handles extend 3-1/2 inches (89mm).  
 2. Handles extend 6-1/4 inches (159mm) standard enclosures for 600 - 800 amp sizes are suitable for top cable entrance only. Specify 42" wide enclosure for bottom cable entry.  
 3. Recommended clearance to enclosure: 3 feet (914mm) from rear, 4 feet (1219mm) from front (25 inches required for transfer switch drawout).  
 4. For 3000 - 4000 amp sizes, ATS and bypass sections can be reversed, contact ASCO. Recommended clearance to enclosure: 3 feet (914mm) from rear, 5 feet (1524mm) from front (3 feet required for transfer switch rollout).

**Shipping Weights**

Automatic Transfer Bypass-Isolation Switching  
with Transfer Switch Engaged 7A TB, 7N TB

Switch Rating amps	Poles	Enclosed lb (kg)	Open* lb (kg)
150, 260, 400	2	340 (154)	135 (61)
150, 260, 400	3	350 (158)	145 (66)
150, 260, 400	3 with C	360 (163)	155 (70)
600, 800	2	695 (315)	370 (168)
600, 800	3	710 (322)	385 (175)
600, 800	3 with B/C	725 (329)	425 (193)
1000, 1200	2	1910 (866)	1280 (507)
1000, 1200	3	2130 (966)	1280 (507)
1000, 1200	3 with B/C	2350 (1066)	1440 (652)
1600, 2000	2	2180 (989)	1300 (589)
1600, 2000	3	2360 (1070)	1550 (702)
1600, 2000	3 with B/C	2540 (1152)	1800 (815)
3000	3	2730 (1240)	1690 (768)
3000	3 with B/C	3360 (1525)	1980 (899)
4000	3	6300 (2858)	-
4000	3 with C	6900 (3130)	-

- Notes: \*Open weights include transfer switch, bypass-isolation switch and control panel.  
 1000-4000 amp enclosures require ventilation openings, refer to drawings for details.  
 Export shipments may require a wooden box, contact ASCO for weights and dimensions.



4016 Quartz Drive  
 Santa Rosa, CA 95405  
 Phone: 707 539-9003  
 Fax: 707 539-5212

Email: sales@generatorjoe.NET  
 Web www.generatorjoe.NET

Automatic Transfer Bypass-Isolation in Closed Transition and Delayed  
Transition Switching. 7A DTB<sup>6</sup>, 7A CTB, 7N DTB<sup>6</sup>, 7N CTB

Switch Rating amps	Poles	Width inches (mm)	Height inches (mm)	Depth inches (mm)
<b>Enclosed UL Type 1</b>				
150, 260, 400 <sup>1,5</sup>	2, 3 or 3 with neutral C	28-1/2 (724)	74 (1880)	19 (483)
600, 800 <sup>2</sup>	2, 3 or 3 with neutral B/C	36 (914)	90 (2286)	22 (559)
1000, 1200 <sup>3</sup>	2, 3 or 3 with neutral B/C	38 (965)	91 (2311)	60 (1524)
1600, 2000 <sup>3</sup>	2, 3 or 3 with neutral B/C	38 (965)	91 (2311)	60 (1524)
3000 <sup>4</sup>	3 or 3 with neutral C	38 (965)	91 (2311)	72 (1829)
4000 <sup>4</sup>	3 or 3 with neutral C	96-1/2 (2451)	91 (2311)	72 (1829)
<b>Open Configuration</b>				
150, 260, 400 <sup>1,5</sup>	2 or 3	14-3/4 (375)	61-1/2 (1553)	22-1/4 (565)
150, 260, 400 <sup>1,5</sup>	2 or 3 with neutral C	19-3/4 (500)	61-1/2 (1553)	22-1/4 (565)
600, 800 <sup>2</sup>	2 or 3	23-3/4 (603)	67-1/4 (1708)	24-3/4 (629)
600, 800 <sup>2</sup>	2, 3 or 3 with neutral B/C	27-1/4 (692)	67-1/4 (1708)	24-3/4 (629)
1000, 1200 <sup>3</sup>	2, 3 or 3 with neutral B/C	38 (965)	72 (1829)	38 (965)
1600, 2000 <sup>3</sup>	2, 3 or 3 with neutral B/C	38 (965)	72 (1829)	38 (965)

- Notes: 1. Handles extend 3-1/2 inches (89mm).  
 2. Handles extend 6-1/4 inches (159mm) standard enclosures for 600 - 800 amp sizes are suitable for top cable entrance only. Specify 44" wide enclosure for bottom cable entry.  
 3. Recommended clearance to enclosure: 3 feet (914mm) from rear, 4 feet (1219mm) from front (25 inches required for transfer switch drawout).  
 4. For 4000 amp size, ATS and bypass sections can be reversed, contact ASCO. Recommended clearance to enclosure: 3 feet (914mm) from rear, 5 feet (1524mm) from front (3 feet required for transfer switch rollout).  
 5. Dimensions for 400 amp, 7A DTB and 7N DTB with neutral code B are 36 (914)W x 90 (2286)H x 22 (559)D.  
 6. Conventional switch neutral is provided on 7A DTB and 7N DTB switching arrangements. When specified optional (Code B).

**Shipping Weights**

Automatic Transfer Bypass-Isolation in Closed Transition and  
Delayed Transition Switching. 7A DTB, 7A CTB, 7N DTB, 7N CTB

Switch Rating amps	Poles	Enclosed lb (kg)	Open* lb (kg)
150, 260, 400	2	340 (154)	145 (66)
150, 260, 400	3	350 (158)	155 (70)
150, 260, 400	3 with C	360 (163)	165 (75)
600, 800	2	695 (315)	385 (175)
600, 800	3	710 (322)	400 (181)
600, 800	3 with B/C	750 (340)	440 (200)
1000, 1200	2	2045 (928)	1225 (556)
1000, 1200	3	2265 (1027)	1415 (642)
1000, 1200	3 with B	2485 (1127)	1575 (714)
1600, 2000	2	2315 (10550)	1435 (651)
1600, 2000	3	2495 (1132)	1685 (764)
1600, 2000	3 with B	2675 (1213)	1935 (878)
3000	3	2730 (1240)	1690 (768)
3000	3 with B	3360 (1525)	1980 (899)
4000	3	6300 (2858)	-
4000	3 with C	6900 (3130)	-

- Notes: \*Open weights include transfer switch, bypass-isolation switch and control panel.  
 1000-4000 amp enclosures require ventilation openings, refer to drawings for details.  
 Export shipments may require a wooden box, contact ASCO for weights and dimensions.

## **ASCO**® Start-Up, Commissioning, Service & Preventive Maintenance

ASCO Services, Inc., provides a wide range of technical services to users of automatic transfer switches in emergency and standby power systems. These services include comprehensive preventive maintenance programs, modifications, upgrades and emergency repairs. Systems serviced range in complexity from a single automatic transfer switch to multiple transfer switches and engine generators.

ASCO Services is a wholly owned subsidiary and the exclusive OEM service arm of ASCO Power Technologies, the world's largest manufacturer of power transfer switching and control equipment. Serving the needs of ASCO's customers is a major focus; however, ASCO Services is also routinely called upon to perform regular maintenance and emergency repairs on equipment manufactured by others.

ASCO Services offers comprehensive maintenance agreements that detail the preventive care needed to keep emergency power systems ready to respond. A service agreement is an effective way to budget in advance and avoid unexpected expenditures. A 35-point checklist is utilized to assure critical systems and components are kept in top operating condition. These preventive programs can be customized for national accounts. This customization permits central corporate control of costs and scheduling. Periodic reports provide detailed information as to activity, maintenance performed and corrective action.



ASCO Services deploys more than 75 service personnel strategically located throughout the nation to provide 24-hour response in emergency situations. Each region is

manned by experienced personnel who receive ongoing support and training in the newest equipment concepts, design and controls. Because equipment can be utilized for a long number of years, field representatives also receive education on older designs. This knowledge can be invaluable in addressing total system concerns, evaluating problems and providing solutions on site. Service vans are equipped with parts and advanced testing equipment that facilitate these on-the-spot repairs. **ASCO** Services 1-800-800-ASCO.



4016 Quartz Drive  
Santa Rosa, CA 95405  
Phone: 707 539-9003  
Fax: 707 539-5212  
Email: [sales@generatorjoe.NET](mailto:sales@generatorjoe.NET)  
Web [www.generatorjoe.NET](http://www.generatorjoe.NET)

## **GeneratorJoe**

