

## *ASCO 4000 Series Power Transfer Switches*





## The Recognized Leader in Power Transfer Switch Technology Offers the Most Advanced Transfer Switches in the World.



- **Commercial Buildings / Industrial Buildings**
- **Telecom Central Offices**
- **Process Manufacturing / Wafer Fabrication Plants**
- **Distributed Power / Load Management**
- **Waste Water Treatment Facilities**

As we become more dependent on the quality and reliability of electrical power, interruption or complete loss of power can create serious and even crippling financial losses, or impose dangers to life and safety.

ASCO Power Technologies (ASCO) provides the solutions to handle the transfer of critical loads to emergency sources reliably and with state of the art products. Using ASCO products can mean the difference between a minor inconvenience and a major catastrophe. You'll find ASCO Power Transfer Switches wherever there is a critical load to be protected.

When flexibility in power switching is a must, ASCO offers a variety of product solutions to meet virtually every application requirement, including distributed generation applications. That's why the 4000 Series is available in open, delayed, and closed transition configurations. Additionally the switched neutral option provides for reliable operation of ground fault protection systems.

ASCO Power Transfer Switches are CE Marked and IEC 60947-6-1 compliant.

# ASCO® 4000 SERIES



Fig. 1: Three Pole 4000 Series Automatic Transfer Switch rated 800 amperes (shown with optional front connected terminals and Power Manager).

## 4000 Series

ASCO Power Transfer Switches are the standard of the industry. High speed transfer of loads between alternate sources of power, regardless of ampacity size, is achieved by a reliable, field proven solenoid operating mechanism. When combined with a programmable microprocessor controller with keypad and LCD display, they offer the most advanced method of transferring all types of loads, such as motors, electronic drives, UPSs and microprocessor based systems. 4000 Series Power Transfer Switches are available open or enclosed, in ampacity sizes from 30 through 4000 amperes with a limited selection of optional accessories.

## 4000 Series Power Transfer Switches Product Features

- Conventional two-position transfer configuration, plus closed and delayed transition modes of operation. All configurations available with either automatic or non-automatic control.
- UL listed to 1008 Transfer Switch Equipment & CSA certified to CSA 22.2 No.178-1978 Automatic Transfer Switches.
- Qualified to IEC 60947-6-1, CE marked (optional). (Limited to certain accessories.)
- Rated up to 600 VAC, 30 through 4000 amperes.
- Reliable and field proven solenoid operating mechanism.
- High withstand and close-on ratings including short time withstand current rating for optimum flexibility in circuit breaker coordination (800-4000 amperes).
- Solid, switched neutral configurations available.
- Front replaceable main and arcing contacts (800-4000 amperes).
- Programmable microprocessor controller with keypad and LCD display.
- Industrial grade user interface with integrated controls and indicating lights.
- Convenient one line diagram with switch position and source acceptability LED indicators.
- Standard ground conductor connections.
- Four auxiliary contacts, two contacts closed when switch is in normal position and two contacts closed when switch is in emergency position.\*
- Local/remote communications capability for interfacing with ASCO PowerQuest® or SiteWeb® communication products.

\*Only two contacts standard on 150-400A 4ACTS and 4NCTS

# ASCO® 4000 SERIES POWER SWITCHING SOLUTIONS



Fig. 2: Four pole, Closed-Transition Transfer Switch rated 1000 amperes in Type 1 enclosure.



Fig. 3: Four pole, Delayed-Transition Transfer Switch rated 400 amperes in Type 1 enclosure.

## Closed-Transition Transfer Switching

ASCO Automatic Closed-Transition Transfer Switches feature main contacts that overlap, permitting the transfer of electrical loads without power interruption. The switch transfers in a make-before-break mode if both sources are within acceptable parameters. Control logic continuously monitors source conditions and automatically determines whether the load transfer should be open (conventional non-overlap mode) or Closed-Transition. Available 150 through 4000 amperes.

Closed-Transition Transfer within 5 electrical degrees is achieved passively, without control of engine generator set. Therefore, no additional control wire runs are required between the ATS and engine generator set governor. Plus, protective relaying may not be required under normal operation since the contact overlap time is less than 100 milliseconds (consult your local utility on protective relay requirements).

Failure to synchronize indication, extended parallel time protection, and transfer switch lock out are standard features.

## Delayed-Transition Transfer Switching

ASCO Delayed-Transition Transfer Switches are designed to provide transfer of loads between power sources with a timed load disconnect position for an adjustable time period. Applications include older style variable frequency drives, rectifier banks, and load management applications.

- Available 150 through 4000 amperes.
- Utilizes reliable, field proven solenoid operating mechanisms.
- Mechanical interlocks to prevent direct connection of both sources.
- Indicator light (LED Type) for load disconnect position.
- Adjustable time delay for load disconnect position.

## Non-Automatic Transfer Switching

ASCO Non-Automatic Transfer Switches are electrically operated units which are operated with manual control switches mounted locally or at remote locations.

- Sizes from 30 through 4000 amperes.
- Microprocessor based controller provides for addition of optional accessories.
- Controller prevents inadvertent operation under low voltage conditions.
- Low control circuit operating currents allow for long line runs between remotely mounted manual control switches and the transfer switch.
- Source acceptability lights inform operator if sources are available to accept load.
- Standard inphase monitor can be activated for transferring motor loads.



Fig. 4: Three pole Non-Automatic, electrically operated 200 ampere switch shown in Type 1 enclosure.

## Withstand and Close-On Ratings for all 4000 Series Products<sup>(1)(2)</sup>

Switch Rating (Amps)		UL 1008 Withstand and Close-On Ratings				Specific Breaker Rating	"Any" Breaker (3) Rating	Short Time Withstand Ratings <sup>(4)</sup>	Short Time Duration (Cycles)	Tested Voltages
4ATS, 4NTS	4ACTS, 4ADTS, 4NCTS, 4NDTS	Current-Limiting Fuse Rating	Max. Fuse Type							
			amps	types						
30	-	100,000	60	J	10,000	10,000	N/A	-	480V	
70, 100, 125, 150, 200	-	200,000	200	J	22,000	10,000	N/A	-	480V	
230	-	100,000	300	J	22,000	10,000	N/A	-	480V	
260, 400, 600	150, 260, 400, 600	200,000	600	J	42,000	35,000	N/A	-	600V	
		200,000	800	L						
800, 1000, 1200	800, 1000, 1200	200,000	1600	L	65,000	50,000	36,000	18	600V	
1600, 2000 <sup>5</sup>	1600, 2000 <sup>5</sup>	200,000	3000	L	100,000	100,000	65,000	30	600V	
2600, 3000	2600, 3000	200,000	4000	L	100,000	100,000	65,000	30	600V	
4000	4000	200,000	6000	L	100,000	100,000	65,000	30	480V	

Notes: 1) All values are available symmetrical RMS amperes and tested in accordance with the withstand and close-on requirements of UL 1008. See publication 1128 for more information on withstand and close-on ratings for ASCO transfer switches.

2) Application requirements may permit higher withstand ratings for certain size switches. Contact ASCO for guidance if available short circuit current exceeds the WCR ratings shown.

3) "Any" breaker ratings are based on 1.5 cycles for 30 - 230 amp & 3 cycles for 260 - 4000 amps. Applicable to breakers with instantaneous trip elements.

4) Short time ratings are provided for applications involving breakers that do not have instantaneous trips for system coordination.

5) Optional front connected service limited to 85,000 amps for specific and any breaker rating.

# ASCO® 4000 SERIES MICROPROCESSOR CONTROLLER



Fig. 5: 4000 Series Microprocessor Controller.

The 4000 Series microprocessor controller is used with all sizes of Power Transfer Switches from 30 through 4000 amperes. It represents the most advanced digital controller in the industry and includes, as standard, all of the voltage, frequency, control, timing and diagnostic functions required for most emergency and standby power applications.

Because of severe voltage transients frequently encountered with industrial distribution systems, the microprocessor logic board is separated and isolated from the power board as shown below. This improves electrical noise immunity performance and helps assure compliance with the rigorous transient suppression standards highlighted below.

The 4000 Series microprocessor controller is a Power Control Center which allows the user to easily access detailed information on: system, power source parameters, voltage, frequency and time delay settings, optional feature settings, historical event log, and system diagnostics. A four line, (20) character LCD has a backlit display which enables easy viewing under all conditions. The user can navigate through all screens using only six buttons.

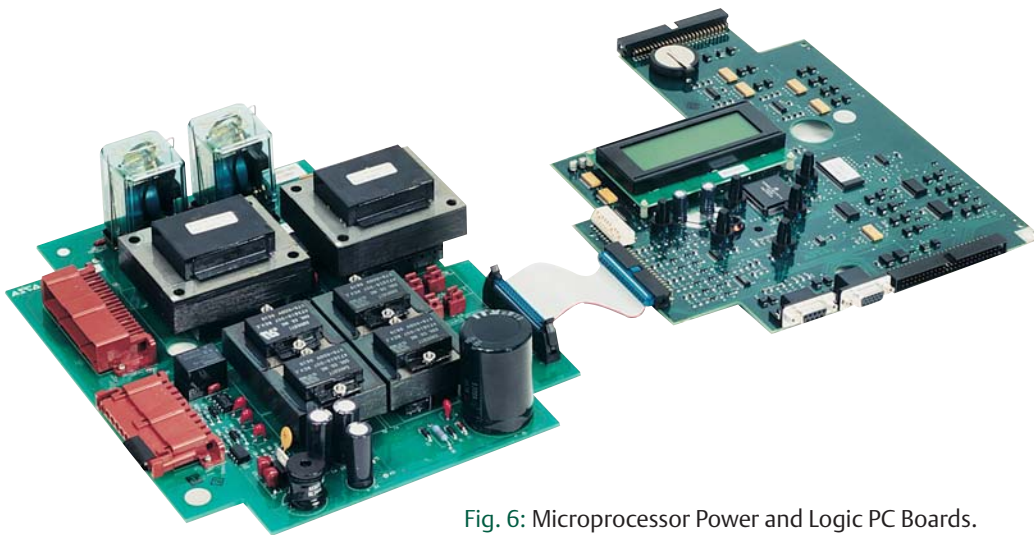


Fig. 6: Microprocessor Power and Logic PC Boards.

4000 Series Microprocessor Controller	
Emission Standard - Group 1, Class A	EN 55011:1991
Generic Immunity Standard, from which:	EN 50082-2:1995
Electrostatic Discharge (ESD) Immunity	EN 61000-4-2:1995
Radiated Electromagnetic Field Immunity	ENV 50140:1993
Electrical Fast Transient (EFT) Immunity	EN 61000-4-4:1995
Surge Transient Immunity	EN 61000-4-5:1995
Conducted Radio-Frequency Field Immunity	EN 61000-4-6:1996
Voltage Dips, Interruptions and Variations Immunity	EN 61000-4-11:1994

# ASCO® 4000 SERIES MICROPROCESSOR CONTROLLER

## Features

- Digital microprocessor.
- Touch pad programming of features and settings without the need for meters, or variable power supplies.
- Sixteen (16) selectable operating voltages available in a single controller.
- On-board diagnostics provide control panel and ATS status information to analyze system performance.
- Displays and counts down active timing functions.
- Selectable multi-language display (English, German, Portuguese, Spanish, or French. For others contact ASCO).
- Password protection to prevent unauthorized tampering of settings.
- Remote monitoring and control with ASCO PowerQuest® and SiteWeb™ communications products. Specify optional accessory 72A or 72E.
- Load shed option for SYNCHROPOWER® bus optimization applications. Specify optional accessory 30B.

## Voltage and Frequency Sensing

- 3-Phase under and over voltage settings on normal and emergency sources.
- Under and over frequency settings on normal and emergency.
- True RMS Voltage Sensing with +/- 1% accuracy; Frequency Sensing Accuracy is +/- 0.2%.
- Selectable settings: single or three phase voltage sensing on normal and emergency; 50 or 60Hz.
- Phase sequence sensing for phase sensitive loads.
- Voltage unbalance detection between phases.

## Status and Control Features

- Output contact (N/O or N/C) for engine-start signals.
- Selection between “commit/no-commit” on transfer to emergency after engine start and normal restores before transfer.
- Advanced inphase algorithm which automatically measures the frequency difference between the two sources and initiates transfer at appropriate phase angles to minimize disturbances when transferring motor loads.
- Event log displays 99 logged events with the time and date of the event, event type, and event reason.
- Output signals for remote indication of normal and emergency source acceptability.
- Statistical ATS/System monitoring data screens which provide:
  - Total number of ATS transfers.
  - Number of ATS transfers caused by power source failure.
  - Total number of days ATS has been in operation.
  - Total number of hours that the normal and emergency sources have been available.

## Time Delays

- Engine start time delay - delays engine starting signal to override momentary normal source outages - adjustable 0 to 6 seconds.
- Transfer to emergency time delay - adjustable 0 to 60 minutes.
- Emergency source stabilization time delay to ignore momentary transients during initial generator set loading - adjustable 0 to 6 seconds.
- Retransfer to normal time delay with two settings:
  - Power failure mode - 0 to 60 minutes.
  - Test mode - 0 to 60 minutes.
- Unloaded running time delay for engine cooldown - adjustable 0 to 60 minutes.
- Fully programmable engine exerciser with seven independent routines to exercise the engine generator, with or without loads, on a daily, weekly, bi-weekly or monthly basis.
- Contains all alarm signals, logic and time delays for use with closed transition switches.
  - Insynch time delay - 0 to 3 seconds.
  - Failure to synchronize - 1 to 5 minutes.
  - Extended parallel time - 0.1 to 1.0 seconds.
  - Transfer switch locked out.
- Delayed transition load disconnect time delay - adjustable 0 to 5 minutes. (Delayed Transition Switches only.)

# ASCO® 4000 SERIES POWER CONTROL CENTER SCREENS

## Status

### System Status

Normal OK  
Load on Normal

Displays system status in clear, concise language. Message shown indicates normal source is acceptable and the load is connected to the normal source.

### Source Status

Normal Source  
Vab=480V.....ABC  
Vbc=480V.....Vunbal=1%  
Vca=480V.....60.0Hz

Displays voltage for each phase, frequency, phase rotation and voltage unbalance for both normal and emergency sources.

### Time Delay Status

Normal OK  
TD.Engine.Cooldown:  
4min15s

Active time delay status displays time remaining until next control event.

### Inphase Transfer Mode

Emerg OK  
Waiting for In-Sync  
-45° 0.02Hz

Displays the relative phase angle between sources and frequency differential to indicate the controller is awaiting an inphase condition.

## Settings

### Voltage and Frequency Settings

Normal Voltage  
Dropout.....85%.408V  
Pickup.....90%.432V  
O.V. Trip.....110%.528V

Provides voltage and frequency setting values for normal and emergency sources. Voltage pick-up, dropout and trip settings are set in percentage of nominal voltage and are also displayed in rms voltage values.

### Time Delay Settings

TD N>E Xfer Signal  
Bypass if N Fail: No  
Pre Xfer: 0 min 20S  
Post Xfer: 0 min 20S

Provides direct reading display for setting time delays.

### Engine Exerciser

P1.....Engine.Exerciser  
Enable:.....Yes....WLoad:....Yes  
Start:19h30. ALL MON  
Run.Time:.....2h15min

Seven independent programs, load/no load selection, flexible run times and daily, weekly, bi-weekly and monthly exercise routines.

### Feature Settings

Shed Load  
Direction: From E  
Inphase: No TD/0.25

Standard features can be activated with the keypad. As an example, when enabled, the “shed load” option causes the transfer switch to transfer the load off of the specified source. If desired, the load shed transfer can be made inphase.

## Data Logging

### ATS Statistics

ATS Statistics  
ATS Total Xfers: 46  
SRC Fail Tot Xfers: 20  
Days Energized: 36.5

Instant availability of statistical information on total number of ATS transfers, number of transfers caused by power failures and total days controller has been energized, plus more.

### Historical Event Log

16.AUG02/95.....13h10:17  
Eng.Start.....NormFail.  
15.AUG02/95.....13h10:25  
Xfer.N>E.....

Displays detailed information for last 99 events, including time of occurrence, length of event, date and reason for event.



# ASCO® 4000 SERIES USER INTERFACE

## User Interface Features

- Convenient One Line Diagram - Provides a clear view of the position of the transfer switch, as well as the acceptability of the Normal and Emergency sources.
- Source Acceptability LEDs - Provide true indication of the acceptability of each source, as determined by the voltage, frequency, voltage unbalance, and phase sequence settings of the control panel.
- Transfer Switch Position LEDs - Provide an indication of which source the transfer switch is connected to.
- Transfer Test - Allows the user to test the operation of the transfer switch under a simulated failure of the normal source. Holding for 15 seconds allows time for the engine generator to come online and the transfer switch to transfer the load.
- Retransfer to Normal - Allows the user to bypass the programmed Retransfer to Normal time delay upon the return of the normal source when the switch has transferred to emergency either during normal operation or a transfer test.

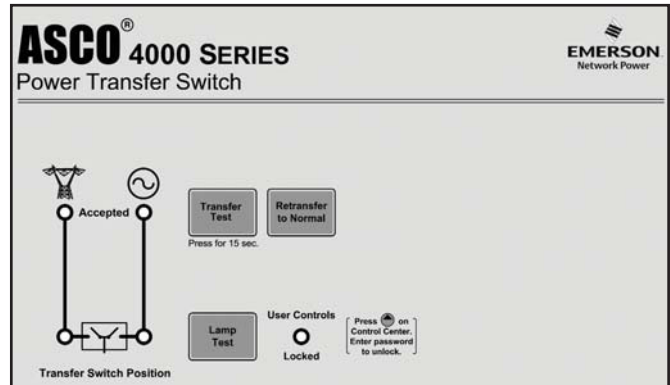


Fig. 7: 4000 Series Open Transition User Interface

- Lamp Test - Provides a convenient way to verify the functionality of all LEDs on the User Interface.
- User Controls Locked - Visually displays the status of the keypad lock feature of the control panel. When illuminated, the buttons of the User Interface are disabled and the user must enter a password into the control panel to unlock the switch. When LED is blinking, the controls are temporarily unlocked for five minutes from the last button pressed.

## Additional Closed Transition User Interface Features

- Extended Parallel Time - Provides visual indication when the pre-set extended parallel time has been exceeded. The controls automatically open the emergency or normal main contacts. Separate contact also available to shunt trip to an external breaker.
- Failure To Synchronize - Visually displays a failure to synchronize alarm if the time delay settings is exceeded, during closed transition transfer operation.
- Transfer Switch Locked Out - Prevents transfer in either direction if the extended parallel time is exceeded.
- Alarm Reset - Resets extended parallel and failure to synchronize alarms.
- Closed Transition Bypass - Pushbutton allows transfer between sources in an open transition mode.

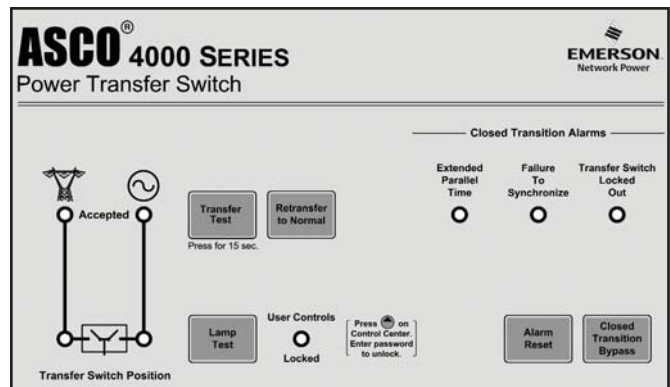


Fig. 8: 4000 Series Closed Transition User Interface

# ASCO® 4000 SERIES OPTIONAL ACCESSORIES

## Time Delays

- 2C** Provides an extended time delay on engine starting. The standard feature one time delay is adjustable from zero to six seconds. Accessory 2C allows this time delay to be adjustable from zero to sixty minutes in one second intervals factory set at five minutes.
- 1G** Similar to accessory 2C except using an external 24 volt DC power input. Available only as a feature of accessory 18Z.

## Indicators

- 14A/14B** Additional auxiliary contact sets to indicate switch position. Two sets are typically standard. Maximum number of two additional sets. (Varies by configuration)

## Neutral Conductor Options

- Solid neutral, with fully-rated terminals. (AL-CU) UL Listed.
- Conventional neutral switching pole.

*Note: Specify neutral option in catalog number, see page 18 for instructions.*

## Communications Options

- 72A** Serial communication module for remote communications to ASCO PowerQuest® or SiteWeb® products. Also allows 4000 Series Transfer Switches to communicate via Modbus/RTU.
- 72E** Ethernet connectivity module for remote communications to ASCO PowerQuest® or SiteWeb® products. Contains embedded web pages for the remote monitoring of ASCO products as well as some 3rd party devices. Also provides Serial-to-Ethernet link with ability to communicate using Modbus/TCP.


## Customer Control Circuits

- 30A** Load-shedding circuit initiated by opening of a customer-supplied contact.
- 30B** Load-shedding circuit initiated by removal of customer-supplied control voltage. (Specify voltage).

## Add-on Boards

- 18Z** Includes one Form C contact (Rated 2A @ 30VDC or .5A @ 125VAC) for each of the following:
  - Normal Source Acceptability.
  - Emergency Source Acceptability.
  - Selective Load Disconnect. - Pre and post transfer signal time delay for selective load disconnect with a programmable bypass on source failures - adjustable 0 to 5 minutes.
  - Fourth contact can be set to mimic the acceptability contacts or annunciate any combination of the acceptability contacts and/or any switch alarm conditions available:
    - Extended Parallel Time (Closed transition),
    - Failure to Synchronize (Closed transition),
    - Transfer Switch Locked Out (Closed transition),
    - Load Disconnected (Delayed transition).
  - Accessory 18Z includes an extension of the engine start time delay (feature) to 60 seconds if an external 24VDC supply is connected to a 4000 series controller. This external power source will also allow the LCD display to be active when both normal and emergency sources are unavailable.
- 18Z2** Includes two 18Z accessory boards. (Maximum of two 18Z accessory boards allowed.)

Fig. 9: 4000 Series Accessory 18Z mounting on User Interface

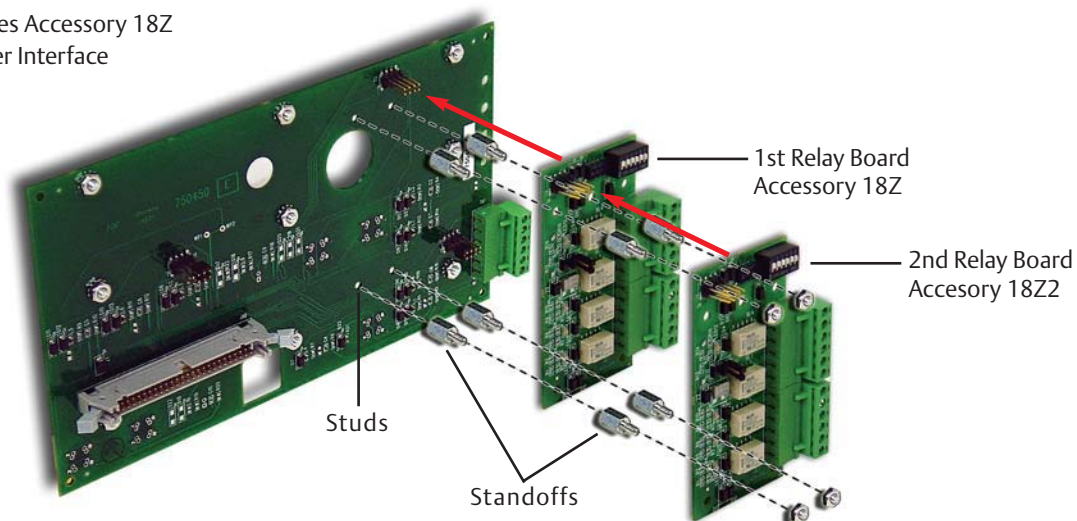

# ASCO® 4000 SERIES OPTIONAL ACCESSORIES

## ASCO® 5200 Series

### Power Manager

The ASCO 5200 Series Power Manager is a microprocessor based metering device that provides real-time measurements of single and three phase power systems. The Power Manager uses digital signal processing technology to measure voltage and current per phase; real, reactive and apparent power, and bi-directional energy. All measurements can be viewed locally with a backlit liquid crystal display and/or displayed remotely with ASCO PowerQuest® or SiteWeb® products.

Direct voltage input for systems up to 600 Volts AC can be monitored without the use of external potential transformers (PTs). Measures three phase currents and a fourth current input is available for measuring current in the neutral conductor. The Power Manager includes one discrete input for transfer switch position, eight general purpose discrete inputs, and four relay outputs for monitoring and controlling external devices.

### Power Metering

- Voltage:
  - Line - Line: VAB, VBC, VCA, VAVERAGE
  - Line - Neutral: VAN, VBN, VCN, VAVERAGE
- Frequency: 45.0 to 66.0 Hertz
- Current: IA, IB, IC, IAVERAGE
- Unbalance %: Voltage, Amps
- Real Power: KWA, KWB, KWC, KWNET
- Reactive Power: KVARA, KVARB, KVARC, KVARNET
- Apparent Power: KVAA, KVAB, KVAC, KVANET
- Real Energy: KWHIMPORT, KWHEXPORT, KWHNET
- Reactive Energy: KVARHIMPORT, KVARHEXPORT, KVARHNET
- Power Factor: PFA, PFB, PFC, PFNET

### Data Access

- Eight digital inputs, four relay outputs.
- Input/Output 15-character, user definable screen display for identification of input/output signals.

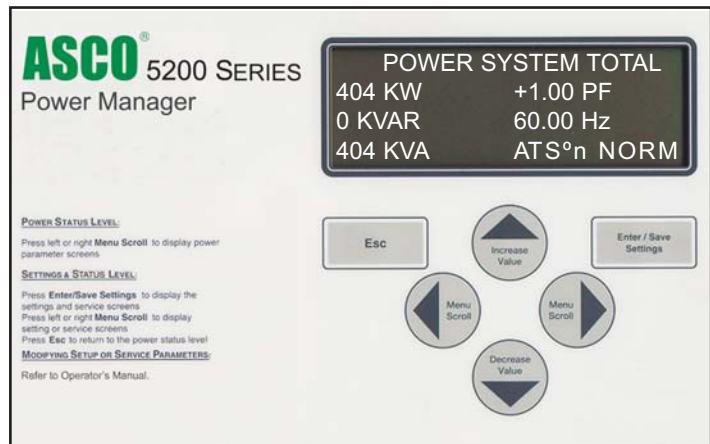


Fig. 10: ASCO 5200 Series Power Manager.

## Configurable Designations

- Local - A four line, 20 character LCD backlit display.
- Remote - With optional Acc. 72A or 72E and Power Manager monitoring systems.
- Provides user programmable setpoints based on twelve metering and I/O parameters. Each setpoint allows the user to select the parameter, the trip & reset levels, the trip & reset time delays and the alarm type or relay output to trigger. This can be used for protective relaying and peak shaving applications.

## Integrated ATS Features

When configured on load of ATS:

- Displays ATS position.
- Displays power data as a function of ATS position (normal/emergency).
- Accumulates energy data separately for normal and emergency sources.

## Optional Configurations and Connection Arrangements

<u>Connected To:</u>	<u>With Display</u>	<u>Without Display</u>
Load	Acc. 85L	Acc. 75L
Normal	Acc. 85N	Acc. 75N
Emergency	Acc. 85M	Acc. 75M

Add suffix "A" to above designations if neutral conductor monitoring is required.

Note: Accessory 75 and 85 includes component mounting, CTs, shorting blocks and all necessary interwiring.

Note: The ASCO Power Manager is also available as a separate unit for monitoring electrical parameters anywhere in the power distribution system.

# ASCO® 4000 SERIES POWER MONITORING & CONTROL


## ASCO Connectivity Solutions

ASCO PowerQuest® and SiteWeb™ communications products allow for the monitoring and control of power transfer switches in your Emergency or Standby Power Distribution System. Local Area networks and Remote networks are supported with either single or multiple points of access, and web-enabled communications allow access to your power system from anywhere around the world.

### Features

- Monitors and Controls Power Transfer Switches and Engine Generators
- Monitors Normal and Emergency Voltage and Frequency
- Indicates Transfer Switch Position and Source Availability
- Provides Transfer and Retransfer of Loads for System Testing
- View Normal and Emergency Voltage and Frequency Settings
- View Transfer Switch Time-Delay Settings
- Provides Transfer Switch Rating and Identification
- Automatic paging notifies personnel, by e-mail or pager, of selected system alarms
- View current, power and power factor with ASCO Power Managers connected to the system
- Adjust and set transfer switch controller parameters
- Activate transfer switch control functions, such as inphase transfer, selective load disconnect time displays and engine exerciser programming
- View Transfer Switch Event Log
- Provides Transfer Switch Test Schedule

## PowerQuest® Typical Network Connection

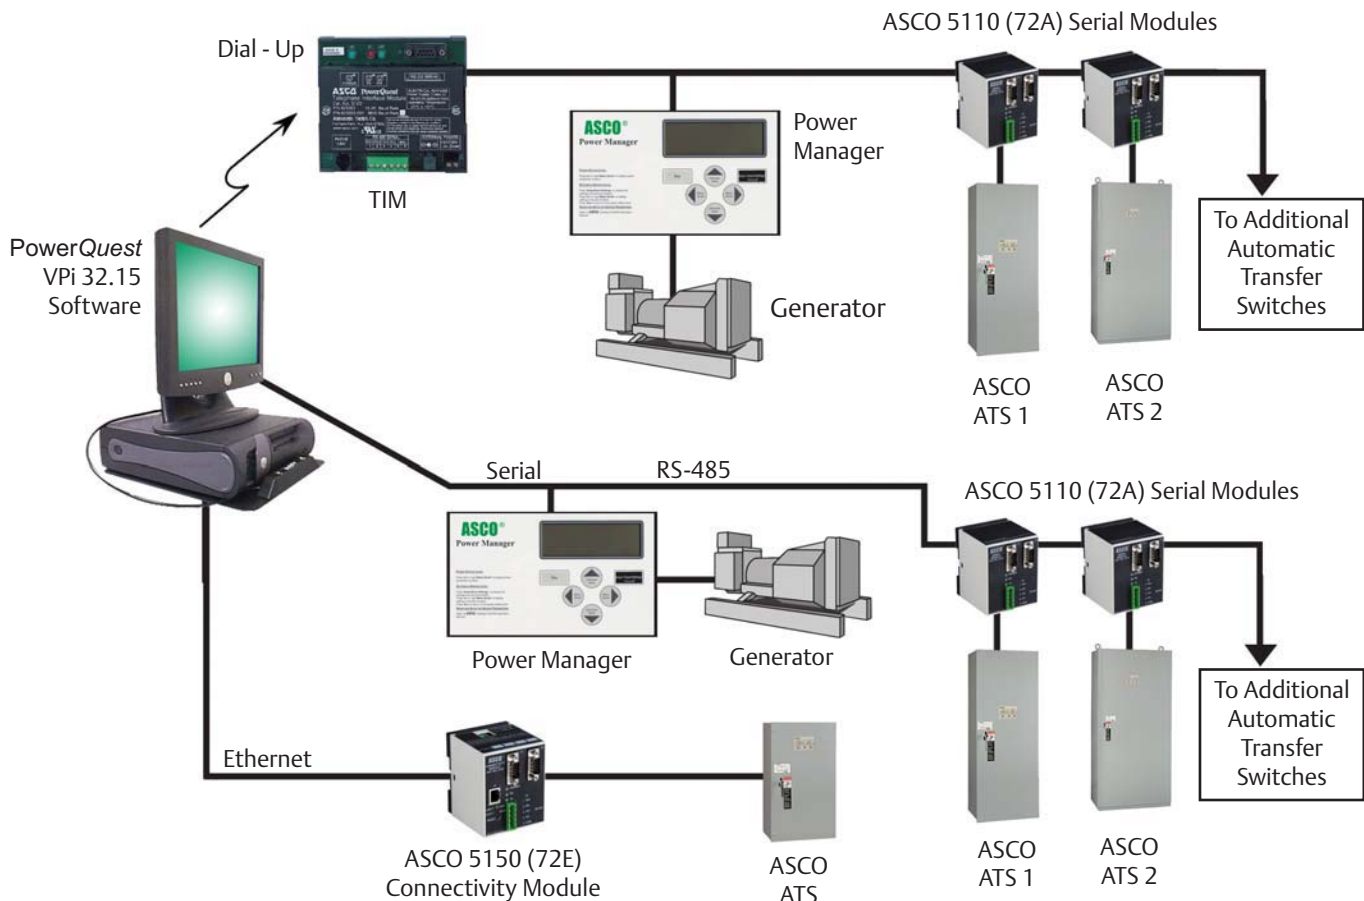

# ASCO® 4000 SERIES POWER MONITORING & CONTROL

PowerQuest® is a PC based software package. When combined with the ASCO 5110 Serial Module, the ASCO 5150 Connectivity module, the ASCO 5120 Telephone Interface Module and ASCO 5200 Series Power Manager, provide the most economical communication system for monitoring and control of power transfer switches and engine generators.

The local RS-485 network allows communications with up to 32 power transfer switches and four engine generators. An analog phone connection and ASCO telephone interface module allow for direct dial up, monitoring and control of remote locations. The ASCO Power Manager not only allows you to view current, power, and power factor readings, but also allows a remote user to control output relays that are not assigned to other setpoints.



Fig. 11: Serial Module

## 5110 Serial Module

The 5110 Serial Module is used to allow local or remote communications with ASCO PowerQuest® or SiteWeb® communication products.

The module is used to connect the 4000 Series transfer switches to a serial network via an RS-485 interface. The module has two port connectors used for ATS & Standalone Power Manager connectivity.

The serial connection is accomplished from a 5-pin terminal header/socket block. RS-485 serial networks allow for up to 32 modules to be set up in a daisy chain configuration to connect to PowerQuest® or SiteWeb® systems.



Fig. 12: Connectivity Module

## 5150 Connectivity Module

The 5150 Connectivity Module is used to bring several different serial devices that communicate at different baud rates and with different protocols to a common Ethernet media.

The module is used to connect 4000 Series transfer switches, and ASCO Remote Annunciators to a standard Ethernet TCP/IP network with standard 10base T(RJ-45) connectors. The module has customized embedded JAVA™ applets (program applications for an internet browser) for each monitored device that loads automatically to a standard Web Browser.

The module is designed to communicate with up to 8 clients such as Web applications (web pages), PowerQuest®, or third party Modbus® devices simultaneously over an Ethernet connection.



Fig. 13: Telephone Interface Module



## 5120 Telephone Interface Module

(for use with PowerQuest®)

The 5120 Telephone Interface Module (TIM) allows users to dial directly into their ASCO communications network for monitoring and/or control. The TIM connects to the ASCO communication network via RS-485 and the phone port connects directly into an analog phone jack. Also, the TIM has an RS-232 connector which allows the TIM to be used as the dialing modem.


Supplied with 120 VAC to 18 VDC (nominal) UL approved, class 2 power supply.

## Summary Screen

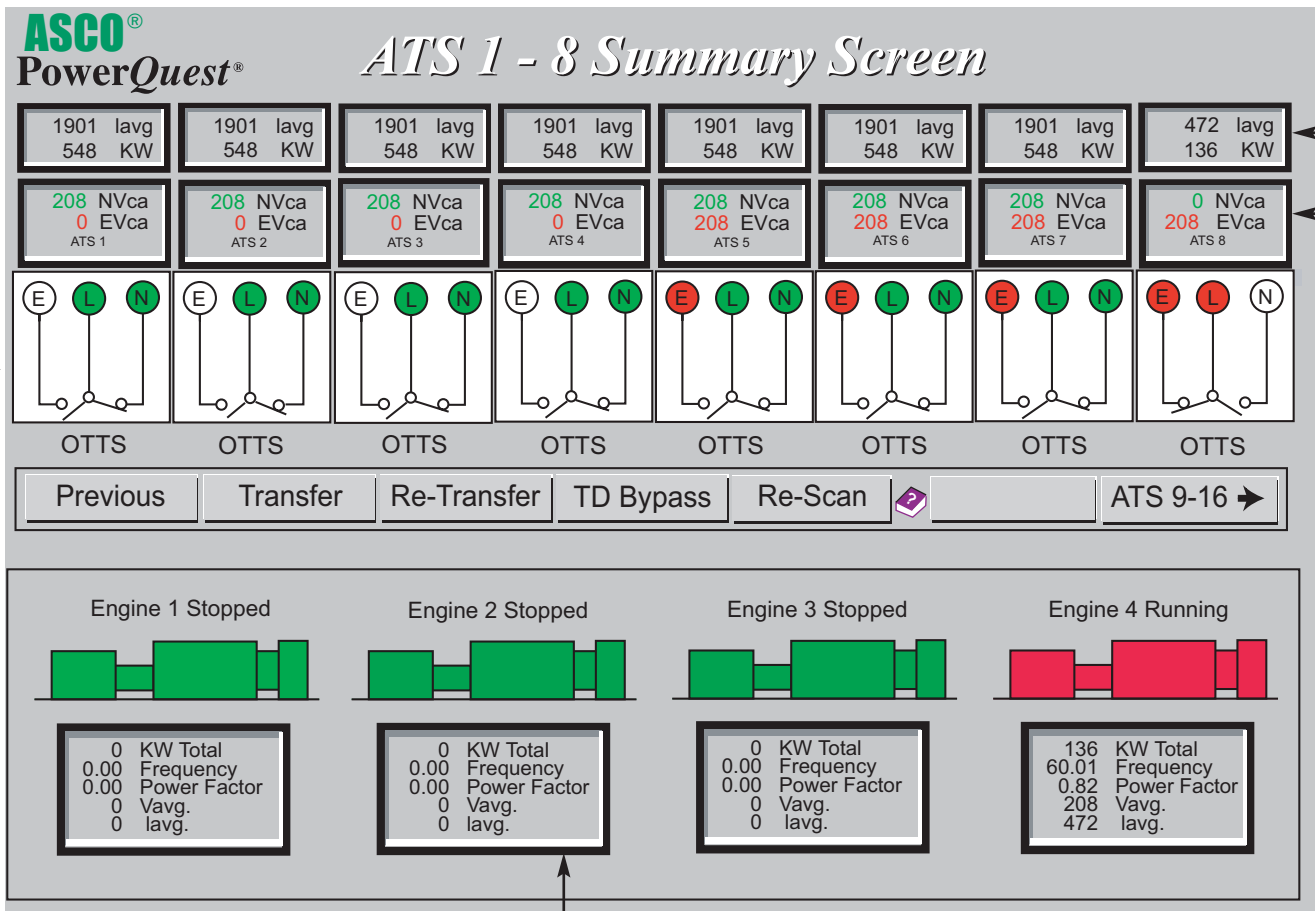

### Convenient One-Line Diagram

- Colored icons highlighted to show source availability and which source is connected to load.
- Contacts move on icon to indicate main contact position of transfer.


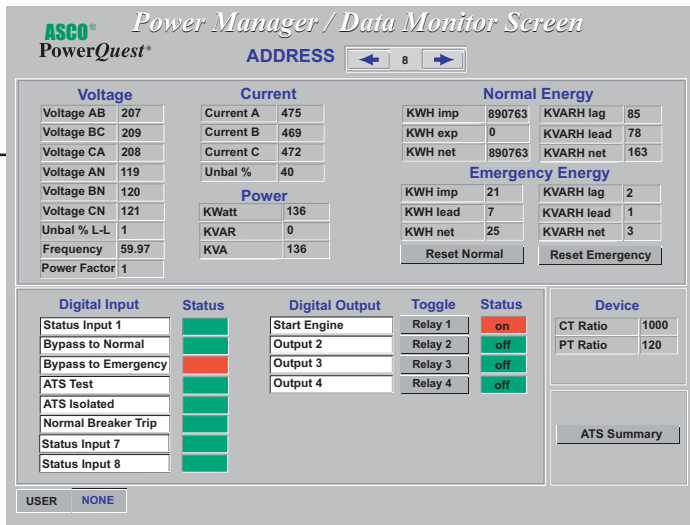


## Power Manager Detail Screen

- Voltage: phase to phase; phase to neutral and voltage unbalance.
- 3 phase currents and neutral (optional).
- Frequency.
- Kilowatt hours - normal and emergency.
- Status and control of four relay outputs.
- Status of eight digital inputs.
- Device ratings: CT and PT ratio.

## Transfer Switch Detail Screen


- ATS rating and identification data is displayed.
- Allows remote testing and time delay bypass.
- Voltage, frequency, phase sequence, voltage unbalance and time delay settings can be checked.
- Viewing of engine exercise schedules.
- Displays phase to phase voltage on normal and emergency.
- Provides complete system status message from 4000 series microprocessor controller.
- View event log on the last 99 events for each ATS.
- Arrange test schedules for transfer switches.
- Provides for monitoring of local site or remote sites.

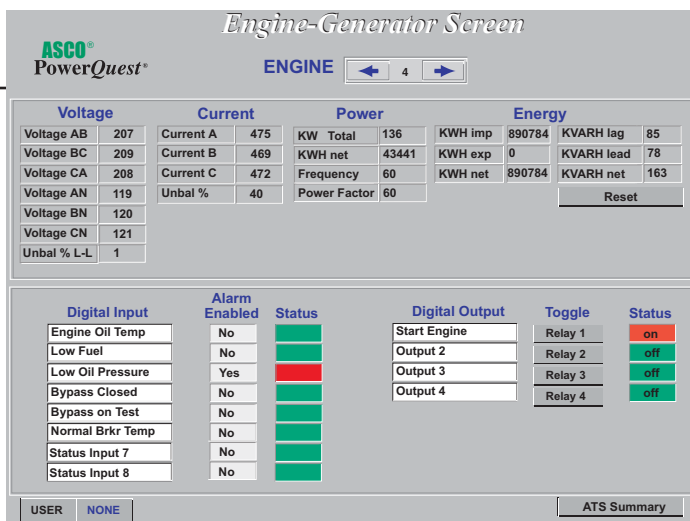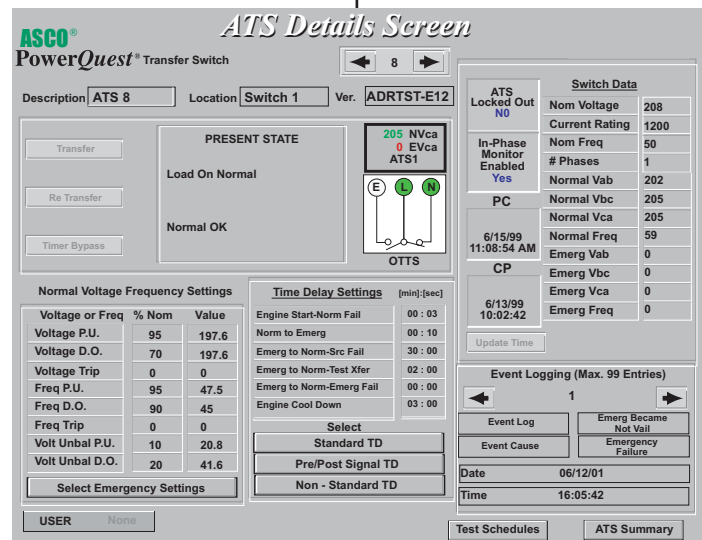

## Engine-Generator Details

- Voltage: Phase to phase; Phase to neutral
- Current for each phase.
- Kilowatts and kilowatt hours total.
- Frequency and power factor.
- Status and control of four digital outputs which can be customized by the user.
- Status of eight digital inputs.
- "Alarm Enabled" selection. These alarms flash the "engine-generator" icon on the summary screen.
- Digital inputs for engine malfunctions are derived from engine mounted sensors (supplied by others).

# ASCO® SiteWeb™

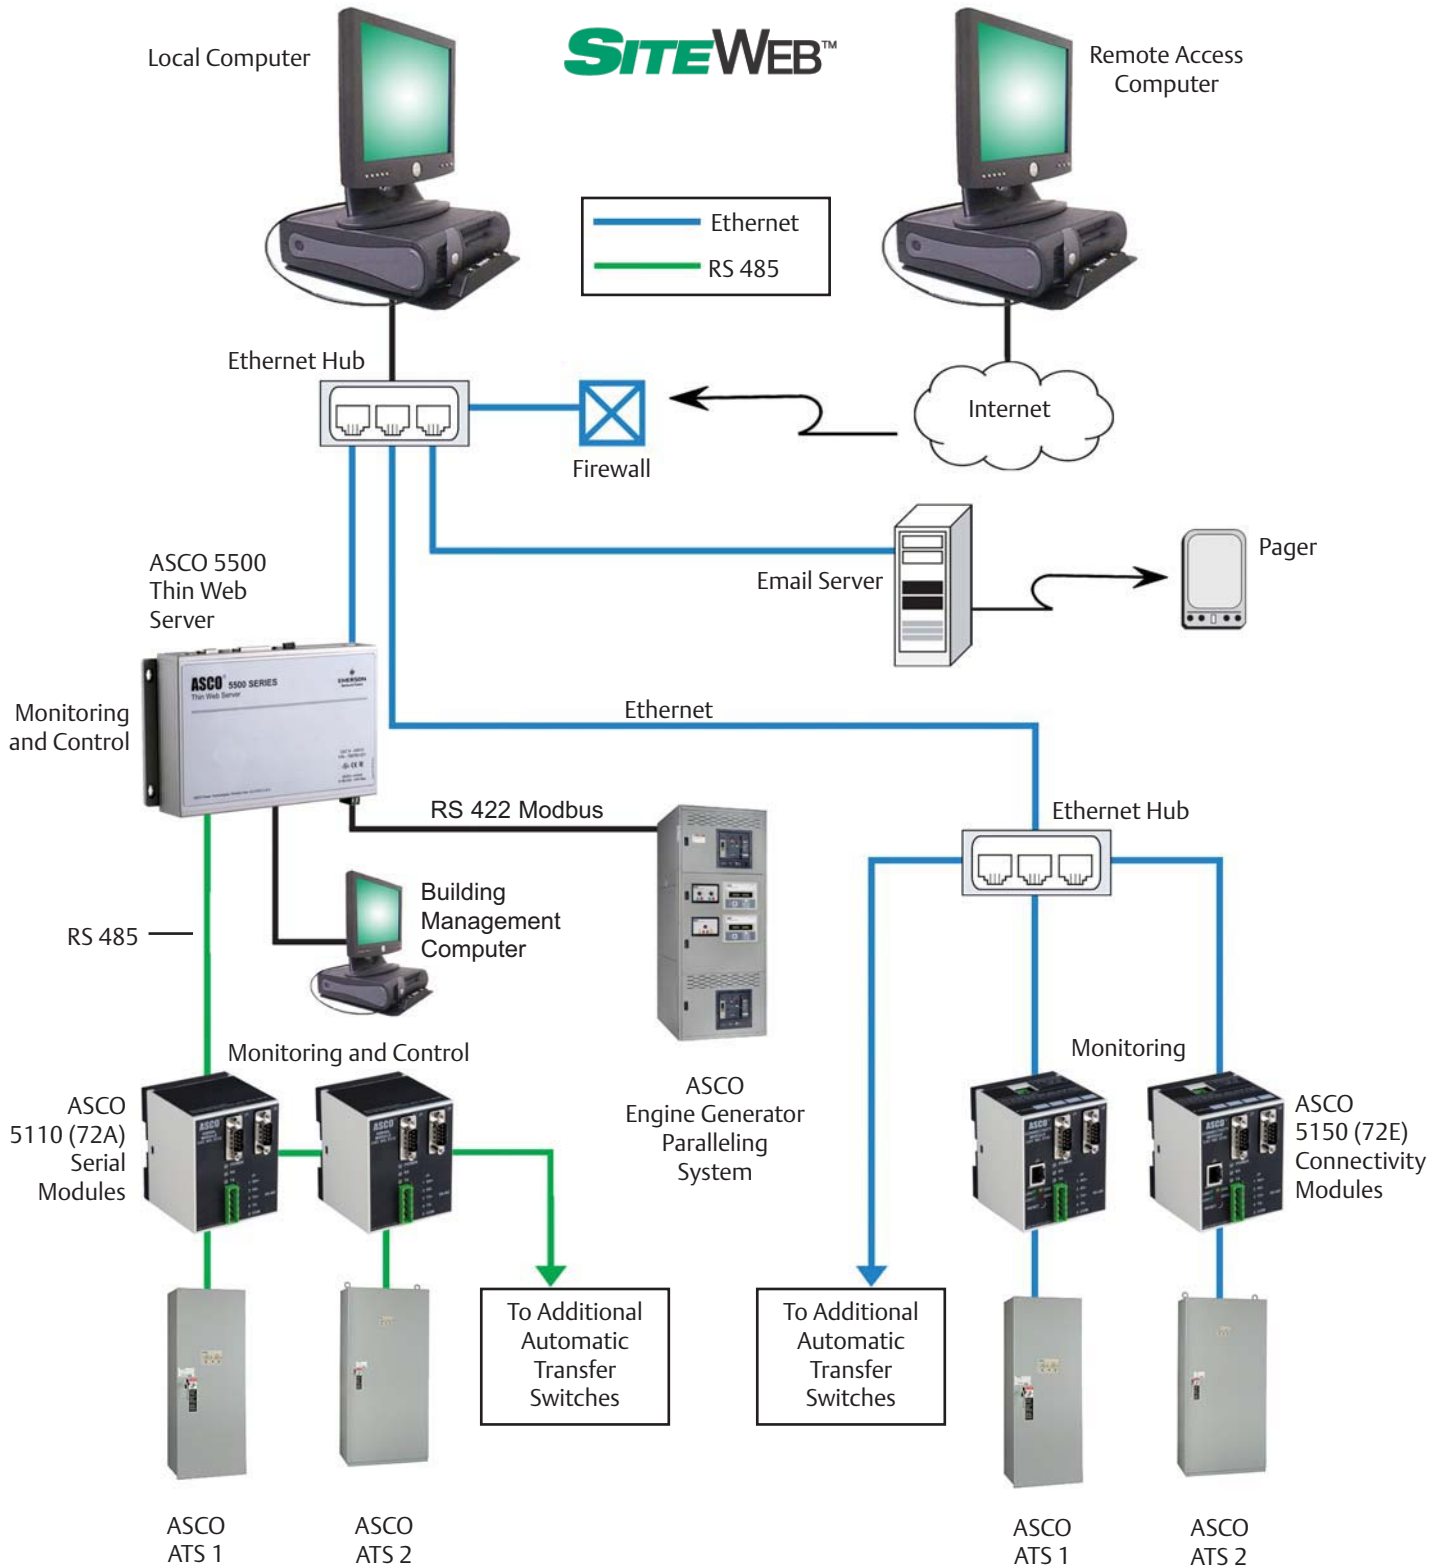



# ASCO® SiteWeb™

SiteWeb™ is a client-server application requiring no software to be installed on the client computer. When combined with the ASCO Communication Interface Modules (Acc 72A / Acc 72E), the ASCO 5500 Series Thin Web Server and the ASCO 5200 Series Power Manager provide the most comprehensive Intranet and Internet communication system for the monitoring and control of power transfer switches and engine generators located in your emergency or standby power distribution system.

The SiteWeb™ communication system allows multiple client access, from local or remote locations, and provides for the monitoring of up to 64 power transfer switches and eight engine generators. In addition, automatic email paging is provided for all alarm signals.



Fig. 14: Thin Web Server

## ASCO® 5500 Series Thin Web Server

The ASCO Thin Web Server allows you to monitor and control transfer switches and engine generators anytime over the Internet or an Intranet from anywhere in the world. It also transmits an email message that an alarm has occurred with one or more of the transfer switches. Plus, this is possible from your home computer or anywhere that has Internet service, using the ASCO Thin Web Server with the SiteWeb™ monitoring and control system.

## Communications Products for 4000 Series Transfer Switches

Description	Acc. Option	Catalog No.
Serial Module	72A	5110
Connectivity Module	72E	5150
Telephone Interface Module for Remote Monitoring*	-	5120
Power Manager with Display*	-	5220D
Thin Web Server*	-	5510E
PowerQuest VPi Software Package*	-	VPi 32.15

\*Note: These products are available as separate items only. They can be ordered by catalog numbers shown in above chart.

## PowerQuest® vs. SITEWEB™

ASCO Connectivity Solution Guide Feature	PowerQuest Vpi 32.15	Thin Web Server with SiteWeb	Series 5150 Connectivity Module
Quantity of Monitored / Controlled Power Transfer Switches per LAN	32	64	1024+
Number of Monitored / Controlled Gensets	4	8	1024+
Control & Monitoring Capability	Yes	Yes	No
Embedded Web Pages	No	Yes	Yes
Ethernet Network Compatible	Yes	Yes	Yes
Monitor Multiple Protocols & Baud Rates (ASCO I, ASCO II, Modbus)	No	No	Yes
Monitor Multiple Sites	Dial-Up	Internet	Intranet
Multiple Client Access	No	Up to 8	Up to 8
Client Software Required	Yes	Internet Explorer	Internet Explorer
Monitors Dissimilar ASCO Controllers on Common LAN	No	No	Yes
Communicates with ASCO Remote Annunciators	No	No	Yes
Email / Paging Alarms	No	Yes	No
Historical Trending Option Alarms	No	Yes	No

# ASCO® 4000 SERIES ORDERING INFORMATION

To order an ASCO 4000 Series Power Transfer Switch, complete the following catalog number:

4   A     TS   +   A   +   3   +   400   +   N   +   5X   +   C  

		Product		Neutral Code*		Phase Poles		Amperes		Voltage Code		Grp Code	Enclosure	
A	Automatic	TS	Conventional 2-Position	---	No Neutral	2	30	1000	A	115	5 5X- optional access- ories	---	No enclosure	
			Closed Transition	A	Solid Neutral	3	70	1200	B	120			C	Type 1 enclosure
	N	Non-Automatic	DTS	Delayed Transition	B	Switched Neutral	100	1600	D	220			F	Type 3R enclosure
							125	2000	E	230			G	Type 4 enclosure
						150	2600	H	380	H	Type 4x enclosure			
						200 <sup>1</sup>	3000	J	400	L	Type 12 enclosure			
						230 <sup>1</sup>	4000 <sup>2</sup>	K	415	M	Type 3R secure double door			
						260		L	440	M	Type 3R secure double door			
						400		M	460	N	Type 4 secure double door			
						600		N	480	P	Type 4X secure double door			
						800		P	550	Q	Type 12 secure double door			
								Q	575					
								R	600					

\*Note: 1. 200 and 230 amp switch limited to 480 volts maximum.

2. Switches rated 30 - 3000 amps available with 2, 3 or conventional switched neutral (B).

For 4 pole applications on switches rated 4000 amps specify neutral code (C).

The Example Catalog Number above is 4ATS A3400N5XC  
(X is used to specify optional accessories).

## Transfer Switch Configurations

4ATS, 4NTS, 4ADTS, 4NDTS, 4ACTS, 4NCTS

### Sizes of UL-Listed Solderless Screw-Type Terminals for External Power Connections

Switch Rating amps	Max # of Conductors per Terminal	Range of AL- CU Conductor Sizes
30 - 230 <sup>1</sup>	One	#14 to 4/0 AWG
260-400	One	#4 AWG to 600 MCM
	Two	#1/0 AWG to 250 MCM
600	Two	#2 AWG to 600 MCM
800-1200	Four	#1/0 AWG to 600 MCM
1600-2000	Six	#1/0 AWG to 600 MCM
3000	Twelve	#1/0 AWG to 600 MCM
4000 <sup>2</sup>	Suitable for Bus Bar Connection or Lugs Can Be Field Modified	

Notes: 1. 200 and 230 amp rating for copper conductors only.

2. All main terminals are rear connected.



## START-UP COMMISSIONING, SERVICE & SCHEDULED MAINTENANCE



ASCO Services Inc., provides a wide range of technical services to users of automatic transfer switches in emergency and standby power systems. These services include comprehensive scheduled maintenance programs, modifications, upgrades and emergency repairs. Systems serviced range in complexity from a single automatic transfer switch to multiple transfer switches and engine generators.

ASCO Services is a wholly owned subsidiary and the exclusive OEM service arm of ASCO Power Technologies, the world's largest manufacturer of power transfer switching and control equipment. Serving the needs of ASCO's customers is a major focus; however, ASCO Services is also routinely called upon to perform regular maintenance and emergency repairs on equipment manufactured by others.

ASCO Services offers comprehensive maintenance agreements that detail the preventive care needed to keep emergency power systems ready to respond. A service agreement is an effective way to budget in advance and avoid unexpected expenditures. A 35 point checklist is utilized to assure critical systems and components are kept in top operating condition. These preventive programs can be customized for national accounts. This customization permits central corporate control of costs and scheduling. Periodic reports provide detailed information as to activity, maintenance performed and corrective action.

ASCO Services deploys more than 75 service personnel strategically located throughout the nation to provide 24-hour response in emergency situations. Each region is manned by experienced personnel who receive ongoing support and training in the newest equipment concepts, design and controls. Because equipment can be utilized for a long number of years, field representatives also receive education on older designs. This knowledge can be invaluable in addressing total system concerns, evaluating problems and providing solutions on site. Service vans are equipped with parts and advanced testing equipment that facilitate these on-the-spot repairs. **ASCO** Services  
1-800-800-ASCO.

# ASCO® 4000 SERIES DESIGNED TO FIT ANYWHERE

## 2-Position Transfer Switching 4ATS, 4NTS

Switch Rating Amps	Poles	Width inches (mm)	Height inches (mm)	Depth inches (mm)
<i>Enclosed UL Type 1<sup>2</sup></i>				
30, 70, 100, 125, 150, 200, 230	2, 3 or 3 with neutral A/B	18 (457)	48 (1219)	13 (330)
260, 400	2, 3 or 3 with neutral A/B	24 (610)	56 (1422)	14 (356)
600	2, 3 or 3 with neutral A/B	24 (610)	63 (1600)	17 (432)
800, 1000	2, 3 or 3 with neutral A/B	34 (864)	72 (1829)	20 (508)
1200	2, 3 or 3 with neutral A/B	38 (965)	87 (2210)	23 (584)
1600, 2000 <sup>1</sup>	2, 3 or 3 with neutral A/B	38 (965)	91 (2311)	48 (1219)
2600, 3000 <sup>1</sup>	2, 3 or 3 with neutral A/B	38 (965)	91 (2311)	60 (1524)
4000 <sup>1</sup>	2, 3 or 3 with neutral A/C	46 (1168)	91 (2311)	72 (1829)
<i>Open Configuration</i>				
30, 70, 100, 125, 150, 200, 230	2, 3 or 3 with neutral B	10-1/4 (260)	10-1/4 (260)	5-1/2 (140)
260, 400	2, 3 or 3 with neutral B	18-1/2 (470)	25 (635)	8 (203)
600	2, 3 or 3 with neutral B	19 (483)	30 (762)	9-7/8 (251)
800, 1000, 1200	2, 3 or 3 with neutral B	27 (686)	31 (787)	12-7/8 (327)
1600, 2000	2, 3 or 3 with neutral B	33-1/4 (845)	28 (711)	26-1/4 (667)
2600, 3000	2, 3 or 3 with neutral B	33-1/4 (845)	28 (711)	30-3/4 (781)
4000	2, 3 or 3 with neutral C	41 (1041)	52 (1321)	25-1/2 (648)

Notes:

1. Enclosures for 1600 - 4000 amp are free-standing with removable top, sides, and back.

2. Consult ASCO for dimensions on enclosures other than UL type 1.

## Shipping Weights

### 2-Position Transfer Switching 4ATS, 4NTS

Switch Rating Amps	Poles	Enclosed lb (kg)	Open lb (kg) *
30, 70, 100, 125	2	67 (31)	15 (7)
30, 70, 100, 125	3	70 (32)	18 (8)
30, 70, 100, 125	3 with B	73 (33)	21 (10)
150, 200, 230	2	69 (32)	17 (8)
150, 200, 230	3	72 (33)	20 (9)
150, 200, 230	3 with B	75 (34)	23 (11)
260, 400	2	216 (98)	82 (37)
260, 400	3	223 (101)	89 (40)
260, 400	3 with B	230 (105)	102 (46)
600	2	316 (143)	88 (40)
600	3	324 (147)	96 (44)
600	3 with B	332 (151)	104 (47)
800, 1000	2	400 (182)	150 (68)
800, 1000	3	420 (192)	170 (78)
800, 1000	3 with B	446 (203)	196 (90)
1200	2	685 (312)	150 (68)
1200	3	705 (321)	170 (78)
1200	3 with B	731 (333)	196 (90)
1600, 2000	2	1110 (503)	370 (167)
1600, 2000	3	1160 (525)	420 (190)
1600, 2000	3 with B	1210 (548)	470 (213)
2600, 3000	2	1365 (620)	405 (184)
2600, 3000	3	1430 (649)	470 (213)
2600, 3000	3 with B	1495 (679)	535 (243)
4000	2	2208 (1002)	975 (443)
4000	3	2433 (1104)	1200 (545)
4000	3 with C	2533 (1149)	1300 (590)

Notes:

\*Open weights include transfer switch and control panel. 1200-4000 amp enclosures require ventilation openings, refer to drawings for details. Export shipments may require a wooden box, contact ASCO for weights and dimensions. Weights and dimensions are approximate and subject to change without notice. For current weights and dimensions contact ASCO product management.

# ASCO® 4000 SERIES DESIGNED TO FIT ANYWHERE

## Closed Transition and Delayed Transition Transfer Switching 4ACTS, 4NCTS, 4ADTS, 4NDTS

Switch Rating Amps	Poles	Width inches (mm)	Height inches (mm)	Depth inches (mm)
<i>Enclosed UL Type 1<sup>2</sup></i>				
150, 260, 400	2, 3 or 3 with neutral A/B	24 (610)	56 (1422)	14 (356)
600	2, 3 or 3 with neutral A/B	24(610)	63 (1600)	17(432)
800, 1000	2, 3 or 3 with neutral A/B	34 (864)	72 (1829)	20 (508)
1200	2, 3 or 3 with neutral A/B	38 (965)	87 (2210)	23 (584)
1600, 2000 <sup>1</sup>	2, 3 or 3 with neutral A/B	38 (965)	91 (2311)	48 (1219)
3000 <sup>1</sup>	2, 3 or 3 with neutral A/B	38 (965)	91 (2311)	60 (1524)
4000 <sup>1</sup>	2, 3 or 3 with neutral A/C	46 (1168)	91 (2311)	72 (1829)
<i>Open Configuration</i>				
150, 260, 400	2, 3 or 3 with neutral B	18-1/2 (470)	25 (635)	8 (203)
600	2, 3 or 3 with neutral B	19 (483)	30 (762)	9-7/8 (251)
800, 1000, 1200	2, 3 or 3 with neutral B	27 (686)	31 (787)	12-7/8 (327)
1600, 2000	2, 3 or 3 with neutral B	33-1/4 (845)	28 (711)	26-1/4 (667)
3000	2, 3 or 3 with neutral B	33-1/4 (845)	28 (711)	30-3/4 (781)
4000	2, 3 or 3 with neutral C	41 (1041)	52 (1321)	29-1/2 (749)

Notes:

1. Enclosures for 1600 - 4000 amp are free-standing with removable top, sides, and back.
2. Consult ASCO for dimensions on enclosures other than UL type 1.

## Shipping Weights

### Closed Transition and Delayed Transition Transfer Switching 4ACTS, 4NCTS, 4ADTS, 4NDTS

Switch Rating Amps	Poles	Enclosed lb (kg)	Open* lb (kg)
150, 260, 400	2	235 (107)	101 (46)
150, 260, 400	3	242 (110)	108 (49)
150, 260, 400	3 with B	250 (113)	115 (52)
600	2	335 (152)	107 (48)
600	3	343 (156)	115 (52)
600	3 with B	352 (159)	124(56)
800, 1000	2	420 (192)	175 (80)
800, 1000	3	450 (205)	205 (94)
800, 1000	3 with B	480 (219)	235 (108)
1200	2	710 (324)	175 (80)
1200	3	740 (337)	205 (94)
1200	3 with B	770 (351)	235 (108)
1600, 2000	2	1300 (590)	505 (229)
1600, 2000	3	1350 (612)	555 (252)
1600, 2000	3 with B	1400 (635)	605 (274)
2600, 3000	2	1555 (706)	540 (245)
2600, 3000	3	1620 (735)	660 (300)
2600, 3000	3 with B	1685 (765)	725 (329)
4000	2	2360 (1071)	1127 (511)
4000	3	2580 (1171)	1347 (611)
4000	3 with C	2680 (1217)	1447 (657)

Notes:

- \*Open weights include transfer switch and control panel. 1200-4000 amp enclosures require ventilation openings, refer to drawings for details. Export shipments may require a wooden box, contact ASCO for weights and dimensions. Weights and dimensions are approximate and subject to change without notice. For current weights and dimensions contact ASCO product management.

# ASCO Power Technologies®

ASCO Power Technologies  
FLORHAM PARK, NEW JERSEY 07932  
USA

800 800 ASCO  
WWW.ASCOPOWER.COM

ASIA  
AUSTRALIA  
BRAZIL  
CANADA  
GERMANY  
JAPAN  
MEXICO  
SOUTH AFRICA  
SOUTH AMERICA  
UNITED ARAB EMIRATES  
UNITED KINGDOM  
UNITED STATES

## Emerson Network Power.

The world leader in business-critical continuity.

- |                |                                |                                |
|----------------|--------------------------------|--------------------------------|
| ■ AC Power     | ■ Embedded Power               | ■ Outside Plant                |
| ■ Connectivity | ■ Inbound Power                | ■ Precision Cooling            |
| ■ DC Power     | ■ Integrated Cabinet Solutions | ■ Site Monitoring and Services |

[EmersonNetworkPower.com](http://EmersonNetworkPower.com)